

Appendix B Hydrology and Hydraulic Analysis

Table B-1: Flood Locations and Project Tracking Sheet

| Flood ID | Flood Cause | Location | Owner | Model Flooding | Flood Reported | Flood Notes | Flood Resolution [Yes/No/Partial] | Project ID | Project Description |
|----------------|------------------------|--|-----------|----------------|----------------|--|-----------------------------------|------------|--|
| E01 | 1-Pipe Capacity | Wendy Wy at 23rd St | 1-City | Yes | Yes | Catch Basin pipe undersized | Yes | NE02 | Replace 190' of 15" and 18" storm drain with 24" pipe |
| E02 | 1-Pipe Capacity | Near Aviation Blvd | 3-Private | Yes | No | Private pipe undersized | | NE02 | Not a project |
| E03 | 1-Pipe Capacity | Near Aviation Blvd | 3-Private | Yes | No | Private pipe undersized | | NE02 | Not a Project |
| E04 | 5-Other/Combination | South of 33rd St | 3-Private | Yes | No | Private catch basin at low area along in combination with downstream condition at 33rd St main | Yes | NE02 | Replace 1470' of 33" storm drain with 42" pipe |
| E05 | 1-Pipe Capacity | Aviation Blvd at 33rd St | 1-City | Yes | No | Pipe Capacity along Aviation Blvd | Yes | NE02 | |
| E06 | 5-Other/Combination | Near 33rd St | 3-Private | Yes | No | Private catch basin at low area along in combination with downstream condition at 33rd St main | Yes | NE02 | Replace 30' of 18" pipe with 24" pipe |
| E07 | 5-Other/Combination | South of 33rd St | 3-Private | Yes | No | Private pipes capacity and capacity of main along 33rd St/Aviation Blvd | Yes | NE02 | Replace 960' of 27" storm drain along 33rd St with 36" pipe diameter. |
| E08 | 5-Other/Combination | South of 33rd St | 3-Private | Yes | No | Private pipes capacity and capacity of main along 33rd St/Aviation Blvd | Yes | NE02 | Replace 400' of 8" private pipe with 15" pipe |
| E09 | 5-Other/Combination | South of 33rd St | 3-Private | Yes | No | Private pipes capacity and capacity of main along 33rd St/Aviation Blvd | Yes | NE02 | Replace 960' of 27" storm drain along 33rd St with 36" pipe diameter. |
| E10 | 5-Other/Combination | South of 33rd St | 3-Private | Yes | No | Private pipes capacity and capacity of main along 33rd St/Aviation Blvd | Yes | NE02 | |
| E11 | 1-Pipe Capacity | East of Market Pl | 3-Private | Yes | No | Private pipe undersized | Yes | NE02 | Replace 900' of 12" private pipe with 18" pipe |
| E12 | 5-Other/Combination | Marriot Golf Field | 1-City | Yes | Yes | Golf course sump intended to be used as storm drain storage | | | Not a project |
| E13 | 2-Curb Outlet | 21st St near Meadows Ave | 1-City | Yes | No | Lack of piping along street | Yes | NE05 | Proposed 140' of 18" storm drain on 18th St |
| E14 | 2-Curb Outlet | 21st St east of Meadows Ave | 1-City | Yes | No | Lack of piping along street | Yes | NE05 | Proposed 1000' of 24" storm drain on 21st St Replace 40' of 18" storm drain with 24" diameter, on 21st St. Replace 630' of 24" storm drain with 30" diameter, on 21st St. Replace 60' of 30" pipe with 36" |
| E15 | 5-Other/Combination | 19th St east of Meadows Ave | 1-City | Yes | No | Combination of pipe capacity/inlet capacity and tailwater due to curb outlet flood downstream at 21 St | Yes | NE05 | Construct drywell size of D=10', depth d=15' and connect to CB structure. |
| E16 | 5-Other/Combination | 23rd at Peck Ave | 1-City | Yes | Yes | Flow travels from 21st Street flood contributing to the flooding. | Yes | NE05 | Resolved by project E10 |
| E17 | 1-Pipe Capacity | Herrin Ave south of 23rd St | 1-City | Yes | No | Undersized main between 23rd and 21st St | Yes | NE06 | Replace 340' of 30" and 24" storm drain with 36" diameter, on Herrin Ave from 23rd St to 21st St. Replace 370' of 42" storm drain with 54" diameter, on Herrin Ave from 21st St to 19th St. |
| E18 | 1-Pipe Capacity | 19th St at Redondo | 1-City | Yes | No | Undersized catch basin pipes and main along 19th street, in combination with downstream condition at main on Herrin Ave. | Partial | NE06 | Replace 100' of 12" CB pipes to 18" diameter, on Redondo at 19th St. Replace 600' of 24" pipe on 19th St with 30" diameter (from Redondo Ave to Herrin Ave). Replace 250' of 63" main on Herrin Ave from Pulliwog park to 18th St with 72". Construct drywell size of D=20', depth d=15' and connect to CB structure. |
| E19 | 2-Curb Outlet | 18th St north of Pulliwog Park | 1-City | Yes | Yes | Lack of piping along 18th St | Yes | NE06 | Proposed 250' of 24" storm drain on 18th St. Replace 110' of 21" storm drain on 18th St with 24" diameter. |
| E20 | 5-Other/Combination | Pulliwog Park | 1-City | Yes | Yes | Pulliwog Park used as storage basin. | | NE06 | No Project |
| E21 | 2-Curb Outlet | Manhattan Beach Blvd east of Redondo Ave | 1-City | Yes | No | Lack of piping along 12th St | Yes | NE02 | Proposed 80' of 18" storm drain to connect curb outlets on 12th St east from Redondo Ave CB. |
| E22 | 1-Pipe Capacity | 11th St just west of Redondo | 2-County | Yes | No | Catch Basin pipe undersized | Yes | C06 | Replace 40' of 18" CB pipe with 24" pipe |
| E23 | 1-Pipe Capacity | 11th St at Redondo Ave | 2-County | Yes | No | County Main Undersized | Yes-With County Upgrade | C06 | Replace 150' of 4'x6' rectangular County main on 11th St at Redondo Ave with 4'x8' rectangular box pipe |
| E24 | 2-Curb Outlet | 9th St west of Harkness St | 1-City | Yes | No | Lack of piping along 9th St | Yes | C06 | Proposed 260' of 18" storm drain to connect curb outlets on 9th St to County system on 9th St. |
| E25 | 2-Curb Outlet | 9th St east of Peck Ave | 1-City | Yes | Yes | Lack of piping | Yes | C06 | Proposed 1220' of 18" storm drain to connect curb outlets on 9th St to Redondo Ave CB. |
| E26 | 1-Pipe Capacity | 3rd St east of Harkness St | 2-County | Yes | No | County mains and catch basin connected to it | Yes-With County Upgrade | C07 | Replace 42' of 42" County main crossing 5th st to 60" diameter. Replace 30' of 36" County main crossing 3rd st to 42" diameter. Replace 70' of 42" County main (just south of 3rd st) to 48" diameter. Construct drywell size of D=20', depth d=20' and connect to CB structure at 3rd Street. |
| E27 | 2-Curb Outlet | 2nd St east of Redondo Ave | 1-City | Yes | No | Lack of piping at 2nd St | Yes | C07 | Proposed 170' of 18" storm drain to connect curb outlet on 2nd St to County storm drain system on 2nd St. |
| E28 | 1-Pipe Capacity | Aviation Blvd at 1st St | 2-County | Yes | Yes | Undersized County mains and CB pipe | Yes | C07 | Replace 240' of 18" pipe with 24" pipe |
| E29 | 1-Pipe Capacity | Redondo Ave north of Curtis Ave | 2-County | Yes | Yes | Catch Basin pipe undersized | Yes | M02 | Replace 30' of 18" CB pipe with 24" pipe |
| E30 | 2-Curb Outlet | Voorhees Ave at Redondo Ave | 1-City | Yes | Yes | Lack of piping | Yes | M02 | Proposed 480' of 24" storm drain to connect curb outlet on Redondo Ave from Voorhees Ave to north of Curtis Ave. |
| E31 | 1-Pipe Capacity | Artesia Blvd at Aviation Wy | 1-City | Yes | Yes | Catch Basin pipes undersized | Yes | M05 | Replace 150' of 18" CB pipes with 24" pipe. Artesia Blvd (just east of Aviation Blvd) |
| E32 | 1-Pipe Capacity | Nelson Ave east of Peck Ave | 1-City | Yes | No | Catch Basin pipe undersized | Yes | M04 | Replace 40' of 8" CB pipe with 18" pipe |
| E33 | 2-Curb Outlet | Peck Ave north of Artesia Blvd | 1-City | Yes | No | Lack of Piping | YES | M04 | Proposed 440' of 24" storm drain to connect curb outlet on Peck Ave to County system on Artesia Blvd |
| E34 | 2-Curb Outlet | Tennyson St at Sepulveda Blvd | 1-City | Yes | No | Connecting to Hermosa storm drain system | | | Not a Project |
| E35 | 1-Pipe Capacity | Rosecrans Ave at Aviation Blvd | 1-City | Yes | Yes | Pipe connecting LACPW system undersized | Yes | NE01 | Replace 80' of 21" storm drain with 30" pipe |
| E36 | 1-Pipe Capacity | South of Rosecrans Ave | 3-Private | Yes | No | Caused by downstream conditions due to undersized pipe connecting LACPW system. | Yes | NE01 | Replace 160' of 18" private storm drain with 24" pipe |
| C01 | 1-Pipe Capacity | South of 36th Pl (DPW Yard) | 1-City | Yes | No | Undersized pipes at DPW connecting to Bell Ave | | NEW2A/B | Not a Project |
| C02 | 6-Downstream Condition | Bell Ave (near 35th St) | 1-City | Yes | Yes | High water level at Bell Ave main | Yes | NEW2A/B | Replace 300' of 54" storm drain main in Bell Ave north of 27th St with 66" diameter. *Construct drywell size of D=40', depth d=40' and connect to catch basin at bell Ave just north of 33rd Pl. |

Table B-1: Flood Locations and Project Tracking Sheet

| Flood ID | Flood Cause | Location | Owner | Model Flooding | Flood Reported | Flood Notes | Flood Resolution [Yes/No/Partial] | Project ID | Project Description |
|----------|------------------------|--|-----------|----------------|----------------|--|-----------------------------------|------------|---|
| C03 | 6-Downstream Condition | Bell Ave | 1-City | Yes | Yes | Due to high water level at Bell Ave Retention gallery and due to high water level at Bell Ave main | Yes | NW02A/B | Construct drywell size of D=20', depth d=20' and connect to catch basin at 30th St. |
| C04 | 5-Other/Combination | 30th St (close to Bell Ave) | 1-City | Yes | Yes | Combination of pipe undersized at 30th St and due to high water level at Bell Ave main | Yes | NW02A/B | Construct drywell size of D=20', depth d=40' and connect to catch basin at 30th St. |
| C05 | 1-Pipe Capacity | Blanche Rd at 35th Pl | 1-City | Yes | Yes | Undersized pipes at Blanche Rd | Yes | NW03 | Replace 70' of 18" storm drain with 24" diameter, on 31st st at Blanche Rd connecting to 36th St. |
| C06 | 1-Pipe Capacity | Laurel Ave north of 36th pl | 1-City | Yes | No | Undersized pipes at Laurel Ave | Yes-With County Upgrade | NW06 | Replace 160' of 18" storm drain with 24" diameter, on Laurel Ave. |
| C07 | 6-Downstream Condition | Off Maple Ave, south off Rosecrans Ave | 1-City | Yes | No | Undersized County pipes downstream | Yes | NW06 | Construct drywell size of D=20', depth d=20' and connect to CB at Palm Ave County Mains Upsized but |
| C08 | 2-Curb Outlet | 31st St (off Laurel Ave) | 1-City | Yes | Yes | Outlet to street | Yes | NW06 | Construct drywell size of D=10', depth d=20' and connect to curb outlet structure at Laurel Ave. |
| C09 | 6-Downstream Condition | Walnut Ave north of 31st St | 1-City | Yes | Yes | Undersized pipe downstream of flood locations | Yes | NW06 | Replace 760' of 27" and 30" storm drain with 36" diameter, on 31st st at Walnut Ave along 31st until Maple Ave.. |
| C10 | 2-Curb Outlet | End of John St at Valley Dr | 1-City | Yes | No | Outlet to street | Yes | C02 | Proposed 120' of 18" storm drain to connect curb outlet on Ardmore Ave to Valley Dr catch basin. |
| C11 | 2-Curb Outlet | End of Palm Ave at Valley Dr | 1-City | Yes | No | Outlet to street | Yes | C02 | Proposed 190' of 15" storm drain to connect curb outlet on on Ardmore Ave to existing catch basin on the same street east from curb outlet. |
| C12 | 6-Downstream Condition | Walnut Ave (north of Marine Ave) | 2-County | Yes | Yes | Due to high water level at County main along Marine Ave and Poinsettia Ave | Yes-With County Upgrade | C02 | Proposed 50' of 18" storm drain to connect curb outlet on Marine Ave to County main on Marine Ave. Also County main upsized as alternative to rid of flooding. |
| C13 | 5-Other/Combination | 19th Street (east from Pine Ave) | 1-City | Yes | Yes | Pipe section undersized along 19th St, also high water level downstream in County main on Pine St | Yes-With County Upgrade | NW08A/B | Replace 330' of 27" storm drain with 36" diameter, along 19th st. Also County main upsized as alternative to rid of flooding. |
| C14 | 1-Pipe Capacity | 14th St (near to Oak Ave) | 1-City | Yes | Yes | Pipe undersized along 14th St, also high downstream HGL conditions | Yes | NW08A/B | Replace 560' of 33" storm drain with 36" diameter, on 14th st (from Pine Ave to Oak Ave) |
| C15 | 5-Other/Combination | 14th St (west of Magnolia Ave) | 1-City | Yes | Yes | Pipe undersized along 14th St, also low spot at the end of pipeline | Yes | NE07 | Construct drywell size of D=20', depth d=20'. At the end of 14th St, west of Magnolia Ave. |
| C16 | 2-Curb Outlet | Manhattan Beach Blvd east of John St | 1-City | Yes | No | Outlet to street | Yes | C04 | Proposed 1050' of 24" storm drain to connect curb outlet on Manhattan Beach Blvd to County main on Pine Ave at Manhattan Beach Blvd. |
| C17 | 6-Downstream Condition | Poinsettia Ave (south from 11th St) | 2-County | Yes | Yes | Downstream conditions, due to high water level at County main along 11th St. Only County update can solve it | Partial | C04 | County main upsized but partially flooding resolution. Construct drywell size of D=40', depth d=40' at Poinsettia Ave (south from 11th St). |
| C18 | 2-Curb Outlet | 10th Street (east from Poinsettia Ave) | 1-City | Yes | Yes | Outlet to street | Yes | C04 | Proposed 160' of 24" storm drain to connect curb outlet on 10th St with County main on Poinsettia Ave. Replace 390' of existing 15" pipe with 24" and invert corrected to connect to proposed pipe at 10th street. |
| C19 | 2-Curb Outlet | 9th St (east from Poinsettia Ave) | 1-City | Yes | Yes | Combination of pipe capacity and headwater due to curb outlet flood downstream at 10th St | Yes | C04 | |
| C20 | 1-Pipe Capacity | Larsson St (near 8th St) | 1-City | Yes | Yes | Undersized pipeline downstream | Yes | C05 | Replace 410' of 24" storm drain with 36" pipe, and 490' of 16" with 24". Along 6th st and Sepulveda Blvd. |
| C21 | 1-Pipe Capacity | Sepulveda Blvd (north of 6th St) | 1-City | Yes | No | Undersized pipeline downstream | Yes | C05 | |
| C22 | 6-Downstream Condition | Meadows Ave (north from 8th St) | 2-County | Yes | Yes | County main is undersized downstream along Meadows Ave causing back up. Also low spot. | Partial | C03 | County main upsized but partially flood alleviated |
| C23 | 5-Other/Combination | Around Johnson St PS | 2-County | Yes | Yes | County main is undersized downstream along Meadows Ave causing flooding at Johnson PS. Due to high HGL and water levels at wetwell, pumps are working improperly discharging water at high heads | Yes-With County Upgrade | C03 | |
| C24 | 5-Other/Combination | 8th (south of Johnson PS) | 2-County | Yes | Yes | Caused due to downstream flooding at Johnson PS. | Yes-With County Upgrade | C03 | |
| C25 | 2-Curb Outlet | The end of 5th St, close to Rowell Ave | 1-City | Yes | No | Outlet to church parking lot | Yes | C09 | Construct drywell size of D=20', depth d=20' and connect to curb outlet structure at Laurel Ave. |
| C26 | 2-Curb Outlet | Church parking between Meadows Ave and Rowell Ave | 1-City | Yes | No | Outlet to church parking lot | Yes | C09 | |
| C27 | 6-Downstream Condition | 2nd St (east from Meadows Ave) | 2-County | Yes | No | Due to high water level caused of pipe capacity of County main at Meadows Ave | No | C09 | Construct drywell size of D=40', depth d=40' and connect to MH at 2nd Street. |
| C28 | 5-Other/Combination | The end of Terraza Pl (south of 2nd St) | 1-City | Yes | No | Due to high water level caused of pipe capacity of County main at Meadows Ave | Yes | C09 | Replace 410' of 18" pipes to 24" diameter. At the end of Terraza Pl (south of 2nd st) |
| C29 | 5-Other/Combination | Voorhees Storage (between Voorhees Ave and Peck Ave) | 2-County | Yes | Yes | Voorhees Storage overflow | Yes | M01 | Extend or deepen the storage basin to double size of the existing. Needed additional volume V=0.9 ac-ft |
| C30 | 2-Curb Outlet | Meadows Ave (north from Tennyson St) | 1-City | Yes | Yes | Outlet to street | Yes | M03 | Proposed 590' of 18" storm drain to connect curb outlets on Shelley st at Meadows Ave to existing CBMH on Meadows (north of Bryant Pl) |
| C31 | 1-Pipe Capacity | End of Shelley St | 1-City | Yes | Yes | Pipe undersized | Yes | M03 | Replace 60' of 8" storm drain with 15" pipe on Shelley St |
| C32 | 1-Pipe Capacity | Bell Ave (from Marine Ave to 26th St) | 1-City | Yes | Yes | Pipes along Bell Ave undersized | Yes | NW02A/B | Replace 600' of 42" pipes to 48" diameter. Replace 340' of 30" pipes to 36" diameter. Replace 330' of 27" pipes to 30" diameter. Along Bell south of connecting to 27th St. Construct drywell size of D=10', depth d=20' and connect to catch basin structure at Flournoy Rd (south of Marine Ave) |
| C33 | 5-Other/Combination | Marine Ave (east from Bell Ave) | 1-City | Yes | Yes | Due to high water level caused of main capacity along Bell Ave | Yes | NW02A/B | |
| C34 | 1-Pipe Capacity | Ardmore Ave at Flournoy Rd | 1-City | Yes | No | Pipes undersized | Yes | NW02A/B | Replace 40' of 15" storm drain with 18" pipe on Ardmore Ave at Flournoy Rd |
| C35 | 2-Curb Outlet | 18th St (east from Laurel Ave) | 1-City | Yes | Yes | Outlet to street | Yes | NW09 | Proposed 460' of 18" along 18th St to connect curb outlet on 18th St to existing MH on 18th St at Agnes Rd. |
| C36 | 1-Pipe Capacity | Pacific Ave (south of 18th St) | 1-City | Yes | No | Pipes undersized | Yes | NW09 | Replace 440' of 15" storm drain with 18" pipe along AM School from 18th St to AM School basin. |
| C37 | 2-Curb Outlet | 15th Street (east from Deegan Pl) | 3-Private | Yes | No | Outlet to street | Yes | NW09 | Proposed 210' of 18" pipe to connect curb outlet on 15th St to 15th St Basin |
| C38 | 5-Other/Combination | 15th St Storage (American Martyrs School) | 1-City | Yes | Yes | 15th St Storage overflow | Yes | NW09 | Not a project |
| C39 | 2-Curb Outlet | 15th St (west from Laurel Ave, south of 15th St Storage) | 3-Private | Yes | Yes | Outlet to street | Yes | NW09 | Proposed 30' of 18" pipe to connect curb outlet on 15th St to 15th St Basin |
| C40 | 6-Downstream Condition | Rowell Ave (north of Manhattan Beach Blvd) | 2-County | Yes | No | Due to high water level caused of County main capacity along Manhattan Beach Blvd | Yes | C08 | Construct drywell size of D=40', depth d=40' and connect to CB at Rowell Ave |
| C41 | 6-Downstream Condition | Manhattan Beach Blvd (west of Rowell Ave) | 2-County | Yes | No | Due to high water level caused of County main capacity along Manhattan Beach Blvd | Yes | C08 | Construct drywell size of D=20', depth d=20' and connect to CB at Manhattan Beach Blvd |

Table B-1: Flood Locations and Project Tracking Sheet

| Flood ID | Flood Cause | Location | Owner | Model Flooding | Flood Reported | Flood Notes | Flood Resolution [Yes/No/Partial] | Project ID | Project Description |
|----------|------------------------|---|--------|----------------|----------------|--|-----------------------------------|------------|---|
| C42 | 1-Pipe Capacity | The Strand (north from 28th St) | 1-City | Yes | Yes | Pipeline along The Strand is undersized | Yes | NW07 | Replace 240' of 8" storm drain with 18" pipe, and replace 150' of 8" storm drain with 12" pipe. On The Strand, north of 28th Street. |
| W01 | 5-Other/Combination | Strand and 2nd St | 1-City | Yes | No | WO Basin does not infiltrate fast enough. Infiltration Rate 0.3 in/hr. Connecting system to City Line on 2nd | Yes | S01 | WO basin does not infiltrate fast enough for 10-year event. Increase Storm Drain along Strand. 285' - 18", 250' - 12". Tie into line along 2nd to allow for relief. |
| W02 | 5-Other/Combination | Stand and 6th St | 1-City | Yes | No | WO Basin does not infiltrate fast enough. Infiltration Rate 0.3 in/hr. Connecting system to City Line on 6th St. | Yes | S01 | WO basin does not infiltrate fast enough for 10-year event. Add 15' of 12" Storm Drain along Strand to connect WO basin to the 6th St outfall. 15' - 12" |
| W03 | 2-Curb Outlet | Ardmore Ave north of 2nd St | 1-City | Yes | No | Need to connect to the system downstream | Yes | S03 | Add 145' of 18" storm drain to connect curb outlet to downstream system along Ardmore Ave. 145' - 18" |
| W04 | 1-Pipe Capacity | Pipe Capacity starting at DU0013. | 1-City | Yes | No | Pipe Capacity starting at DU0013. Need to increase the pipe size MHLAC0276. | Partial | S03 | Minimal Flooding. Leave as is. |
| W05 | 1-Pipe Capacity | Crest Drive NW of 9th St. | 1-City | Yes | Yes | Pipe is a 6-in pipe. Increase size and remove DS curboutlet. | Yes | S01 | Replace 190' of 6" storm drain with 18" storm drain along 9th St and Crest Dr. 190' - 18" |
| W06 | 2-Curb Outlet | 9th St South of Highland | 1-City | Yes | No | Connect to DS network. There is room. | Yes | S01 | Add 158' of 18" storm drain to connect curb outlet to downstream system along 9th St. 158' - 18" |
| W07 | 1-Pipe Capacity | 9th St and Ocean Dr | 1-City | Yes | No | Increase pipe size. | Yes | S01 | Replaced 145' of 5" storm drain with 12" pipe along 9th Street. Replace 195' of 8" storm drain along the Strand with 12" pipe. 195' - 12", 145' - 12" |
| W08 | 5-Other/Combination | Strand and 9th St | 1-City | Yes | No | WO Basin does not infiltrate fast enough. Infiltration Rate 0.3 in/hr. Connecting system to City Line on 2nd | Yes | S01 | . |
| W09 | 1-Pipe Capacity | Strand and Manhattan Beach | 1-City | Yes | No | Flooding upstream caused by the downstream pipe capacity. | Yes | S01 | . |
| W10 | 5-Other/Combination | Manhattan Beach Blvd and Strand | 1-City | Yes | No | | Yes | S01 | WO basin does not infiltrate fast enough for 10-year event. Replace 255' of 8" storm drain with 12", which includes 12" overflow to the Manhattan Ave outfall. 255' - 12" |
| W11 | 6-Downstream Condition | Manhattan Beach Blvd and Valley Dr. | 1-City | Yes | No | Caused by downstream pipe sizes. | Yes | S02A/B | Replace 1366' of 24" storm drain with 36" pipe along Manhattan Beach Blvd. 1366' - 36" |
| W12 | 2-Curb Outlet | 16th St and Valley Dr | 1-City | Yes | No | | Yes | S02A/B | Replace 95' of 4" storm drain with 12" pipe. 95' - 12" |
| W13 | 2-Curb Outlet | 17th Pl and Valley Dr | 1-City | Yes | No | Leave | Yes | S02A/B | . |
| W14 | 2-Curb Outlet | 19th St and Valley Dr | 1-City | Yes | No | Storage at the ball field south of 20th Pl? | Yes | S02A/B | Replace 280' of 24" storm drain with 30" near Valley Dr and 13th St. Replace 44' of 18" storm drain with 24" pipe near Valle Dr and 15th St. Added 955' of 18" storm drain to connect curb outlets to downstream system on Valley Dr. 955' - 18", 44' - 24", 280' - 30" |
| W15 | 5-Other/Combination | Strand and 21st St | 1-City | Yes | No | WO basin causing tailwater issues. Not sure where to discharge that. Because the surrounding line is County. | Yes | S01 | Add 50' of 18" pipe for an outlet north of 21st Pl to the beach. Replace 175' of 8" pipe with 12" to drain runoff to new outlet. 50' - 18", 175' - 12" |
| W16 | 2-Curb Outlet | 23rd St and Alma Ave | 1-City | Yes | No | Connect to DS network. There is room. | Yes | NW07 | Add 255' of 18" pipe to connect curb outlet to downstream network along 23rd St. 225' - 18" |
| W17 | 5-Other/Combination | Strand and 25th St | 1-City | Yes | No | WO Basins. | Yes | S01 | Add 70' of 12" pipe to create outlet north of 26th St. 70' - 12" |
| W18 | 2-Curb Outlet | 31st St and Vista Dr | 1-City | Yes | No | Curb Outlet and Pipe capacity. Connect Downstream | Yes | NW07 | Replace/relay 115' of 12" storm drain with 12" pipe along 31st St and Vista Dr to connect to downstream system. |
| W19 | 6-Downstream Condition | Bayview Dr and 31st Pl | 1-City | Yes | No | Increase pipe size downstream. | Yes | NW07 | Replace 510' of XX storm drain with 30" pipe along 32nd St. Replace 405' of XX storm drain with 24" pipe along 31st Pl and Highland Ave. Add 420' of 18" storm drain to connect curb outlet to downstream system along 31st St. 510' - 30", 405' - 24", 420' - 18" |
| W20 | 1-Pipe Capacity | Strand and 32nd St | 1-City | Yes | No | | Yes | NW07 | Replace 560' of 8" storm drain along the Strand with 12" pipe. 560' - 12" |
| W21 | 1-Pipe Capacity | Strand and north of 39th St. | 1-City | Yes | No | Increase pipe size. There is capacity DS | Yes | NW01 | Replace 34' of 24" and 81' of 12" storm drain outlet on 39th St with 30" pipe. 116' - 30" |
| W22 | 5-Other/Combination | Strand and 41st St | 1-City | Yes | No | WO basin does not infiltrate fast enough. | Yes | NW01 | Reversed direction and connected to City line. 260' - 12". |
| W23 | 5-Other/Combination | Strand and 43rd St | 1-City | Yes | No | WO basin does not infiltrate fast enough. | Yes | NW01 | Replace 280' of 8" storm drain along Strand with 12" pipe and connect to Rosecrans Ave. 280 - 12" |
| W24 | 1-Pipe Capacity | Rosecrans Ave at Highland Ave | 1-City | Yes | No | Upsize pipe. | Yes | NW01 | VCPD - Remove flood concern |
| W25 | 5-Other/Combination | The Strand and 39th St | 1-City | Yes | No | Upsize downstream receiving pipe. | Yes | NW01 | Replace 283' of 8" storm drain along Strand with 18" pipe. Replace 17' of 8" storm drain along Strand with 12" pipe. 283 - 18". |
| W26 | 1-Pipe Capacity | Morningside Drive north of Manhattan Beach Blvd | 1-City | Yes | No | Upsize profile in addition to downstream pipe along Manhattan beach. | Yes | S02A/B | Increase 524' of 18" storm drain to 30" and increase 40' of an 18" storm drain to 24" pipe along morningside drive. 524' - 30", 40' - 24" |
| W27 | 2-Curb Outlet | 39th Street and Highland Ave | 1-City | Yes | No | | Yes | NW01 | Add 960' of storm drain with a 18" pipe along 39th St and Highland Ave to connect curb outlets to downstream system. 960' - 18" |
| W28 | 2-Curb Outlet | 38th Place and Highland | 1-City | Yes | No | | Yes | NW01 | . |
| W29 | 2-Curb Outlet | Rosecrans Ave south of Highland Ave | 1-City | Yes | No | | Yes | NW01 | Add 520' of 24" storm drain to connect curb outlet along Rosecrans Ave to downstream outlet. 520' - 24" |
| W30 | 2-Curb Outlet | 26th St and Highland Ave | 1-City | Yes | No | | Yes | NW07 | Add 40' of 18" pipe to connect curb outlet to downstream system along 26th Pl. 40' - 18" |
| W31 | 2-Curb Outlet | 26th Place and Highland Ave | 1-City | Yes | No | | Yes | NW07 | VCPD - Remove flood concern |
| W32 | 6-Downstream Condition | 13th Street and Morningside Dr | 1-City | Yes | No | Downstream HGL, upsize downstream pipes and double check. | Yes | S02A/B | . |
| W33 | 6-Downstream Condition | Valley Drive between 13th St and 15th St | 1-City | Yes | No | Downstream HGL, upsize downstream pipes and double check. | Yes | S02A/B | . |
| W34 | 4-Inlet Capacity | Rosecrans and Strand | 1-City | Yes | No | | Yes | NW01 | Replace 50' of 18" storm drain outlet with 30" pipe. Replace 100' of 18" storm drain with 30" pipe. Replace 97' of 8" storm drain along Strand with 12" pipe. 97' - 12", 100' - 30", 50' - 36" |
| W35 | 1-Pipe Capacity | Live Oak Tot Park | 1-City | Yes | No | | Yes | S02A/B | Replace 260' of 8" storm drain with 12" pipe. 260' - 12" |
| W36 | 2-Curb Outlet | 19th St and Live Oak Park | 1-City | Yes | | | Yes | S02A/B | Replace 675' of 10" storm drain with 18" pipe. Add 60' of 8" pipe to convert open channel to closed system. 60' - 8", 675' - 18" |

Theorem

Base Equation: $Q=a \cdot D^m$

Target Equation: $y = m \cdot x + b$

For use in: LINEST([y_values],[x_values],TRUE,FALSE)
Which returns: m b of [y]=m[x] + b

- 1) $\ln(Q = a \cdot D^m)$
- 2) $\ln(Q) = \ln(a) + m \cdot \ln(D)$
- 3) $y = b + m \cdot x$
- 4) $[y] = m[x] + b$

Let $\ln(a) = b$, $\ln(Q) = y$, and $\ln(D) = x$

Where [y] and [x] are natural log values of D, depth, and Q, flow derived from LACFCD Catch basin Capacity charts of appendix D. Or other sources for curves out of LACFCD listed parameters.

Return: $m = m$
 $a = e^b$


Single Grate Inlet Curves (Q_G)

Note: Q is unitized to a standard grate of 3'x2' for all sizes, multiplied by ratio of individual to unit.

For s = 0.002 (Slope class 10)

| | | | |
|---------|----------|----------|----------|
| LACFCD | | | |
| D | 0.3 | 0.6 | 1 |
| x=LN(D) | -1.20397 | -0.51083 | 0 |
| Q | 1.25 | 6.2 | 14.25 |
| y=LN(Q) | 0.223144 | 1.824549 | 2.656757 |

| | | | |
|--------------|---------|----------|----------|
| | m | b | a=e^b |
| Coefficients | 2.03799 | 2.733064 | 15.37994 |

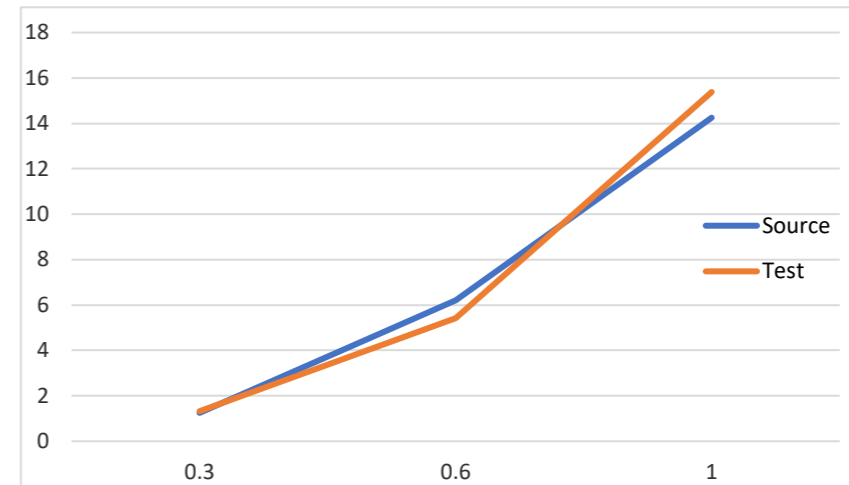


| | | | |
|------|----------|----------|----------|
| Test | | | |
| Dt | 0.3 | 0.6 | 1 |
| Qt | 1.322309 | 5.430365 | 15.37994 |

For s = 0.02 (Slope class 20)

| | | | |
|---------|----------|----------|----------|
| LACFCD | | | |
| D | 0.2 | 0.425 | 0.6 |
| x=LN(D) | -1.60944 | -0.85567 | -0.51083 |
| Q | 1.3 | 6 | 10.75 |
| y=LN(Q) | 0.262364 | 1.791759 | 2.374906 |

| | | | |
|--------------|----------|----------|----------|
| | m | b | a=e^b |
| Coefficients | 1.940181 | 3.400957 | 29.99278 |

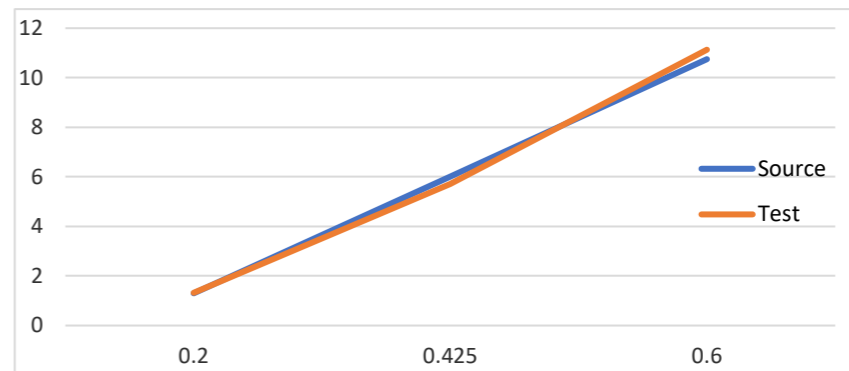


| | | | |
|------|----------|---------|----------|
| Test | | | |
| Dt | 0.2 | 0.425 | 0.6 |
| Qt | 1.320957 | 5.70196 | 11.13243 |

For s = 0.05 (Slope class 50)

| | | | |
|---------|----------|----------|----------|
| LACFCD | | | |
| D | 0.175 | 0.348 | 0.6 |
| x=LN(D) | -1.74297 | -1.05555 | -0.51083 |
| Q | 1.35 | 6 | 13 |
| y=LN(Q) | 0.300105 | 1.791759 | 2.564949 |

| | | | |
|--------------|----------|----------|----------|
| | m | b | a=e^b |
| Coefficients | 1.852362 | 3.595641 | 36.43905 |

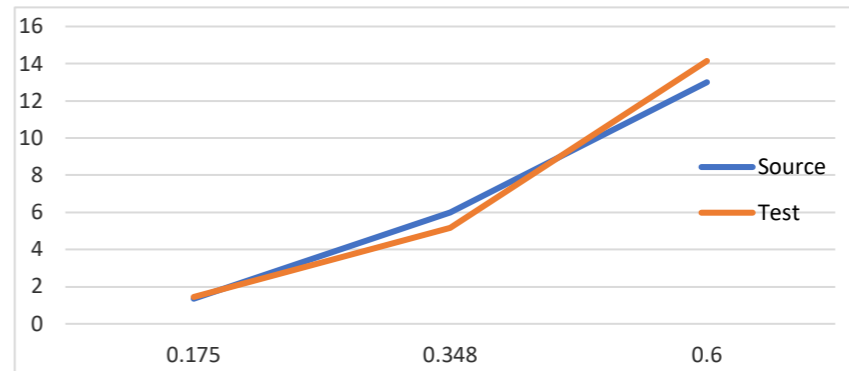


| | | | |
|------|----------|----------|----------|
| Test | | | |
| Dt | 0.175 | 0.348 | 0.6 |
| Qt | 1.443443 | 5.157104 | 14.14565 |

For s = 0.09+ (Slope class 90, Defaults to class 50 when combo)

| | | | |
|---------|----------|----------|----------|
| LACFCD | | | |
| D | 0.15 | 0.32 | 0.6 |
| x=LN(D) | -1.89712 | -1.13943 | -0.51083 |
| Q | 1.27 | 6 | 11.75 |
| y=LN(Q) | 0.239017 | 1.791759 | 2.463853 |

| | | | |
|--------------|----------|----------|----------|
| | m | b | a=e^b |
| Coefficients | 1.619915 | 3.413695 | 30.37727 |

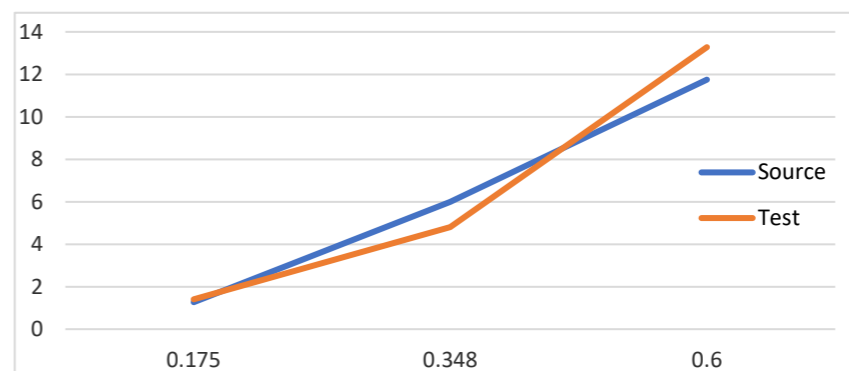

| | | | |
|------|---------|----------|----------|
| Test | | | |
| Dt | 0.15 | 0.32 | 0.6 |
| Qt | 1.40568 | 4.796602 | 13.27922 |


Side Inlet Catch Basin (Q)

Note: Q is scaled per lineal foot based on W=7.0'

For s = 0.005 (Slope class 00) & w=7.0' Used on side inlet only

| | | | |
|---------|----------|----------|----------|
| LACFCD | | | |
| D | 0.3 | 0.6 | 1 |
| x=LN(D) | -1.20397 | -0.51083 | 0 |
| Q | 1.8 | 6 | 14.25 |
| y=LN(Q) | 0.587787 | 1.791759 | 2.656757 |

| | | | |
|--------------|---------|----------|----------|
| | m | b | a=e^b |
| Coefficients | 1.71952 | 2.661645 | 14.31982 |

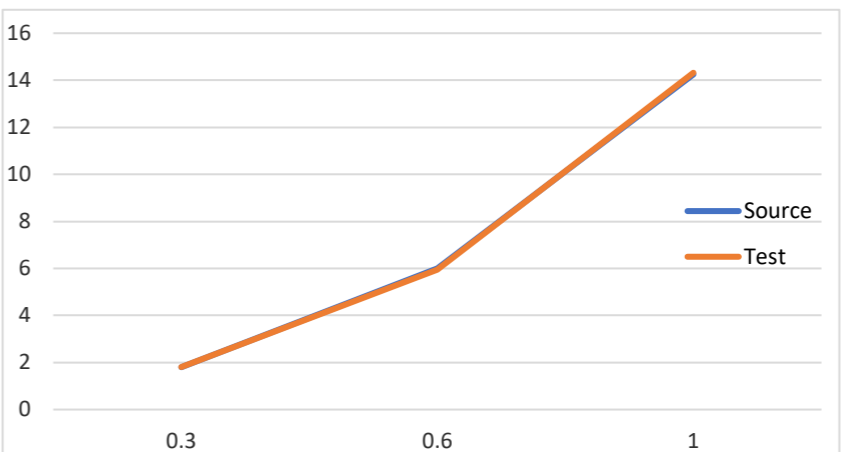


| | | | |
|------|----------|----------|----------|
| Test | | | |
| Dt | 0.3 | 0.5 | 1.5 |
| Qt | 1.806496 | 5.949276 | 14.31982 |

For s = 0.010 (Slope class 10) & w=7.0'

| | | | |
|---------|----------|----------|---------|
| LACFCD | | | |
| D | 0.3 | 0.6 | 1 |
| x=LN(D) | -1.20397 | -0.51083 | 0 |
| Q | 2.1 | 6.5 | 15 |
| y=LN(Q) | 0.741937 | 1.871802 | 2.70805 |


| | | | |
|--------------|---------|----------|----------|
| | m | b | a=e^b |
| Coefficients | 1.63285 | 2.707266 | 14.98824 |

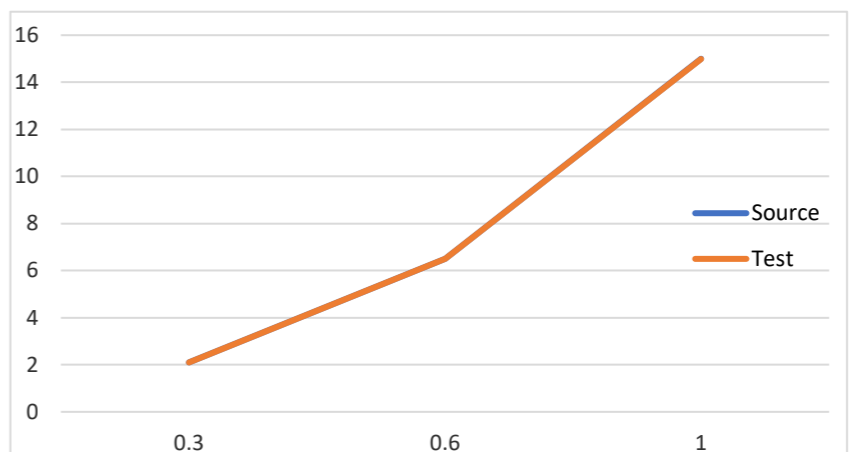

| | | | |
|------|----------|----------|----------|
| Test | | | |
| Dt | 0.3 | 0.5 | 1.5 |
| Qt | 2.098787 | 6.508861 | 14.98824 |


For s = 0.030 (Slope class 30, Q_G:20 when combo) & w=7.0'

| | | | |
|---------|----------|----------|----------|
| LACFCD | | | |
| D | 0.2 | 0.425 | 0.6 |
| x=LN(D) | -1.60944 | -0.85567 | -0.51083 |
| Q | 1.4 | 4 | 7 |
| y=LN(Q) | 0.336472 | 1.386294 | 1.94591 |
| Test | | | |
| Dt | 0.2 | 0.5 | 1.5 |
| Qt | 1.38484 | 4.141183 | 6.835372 |

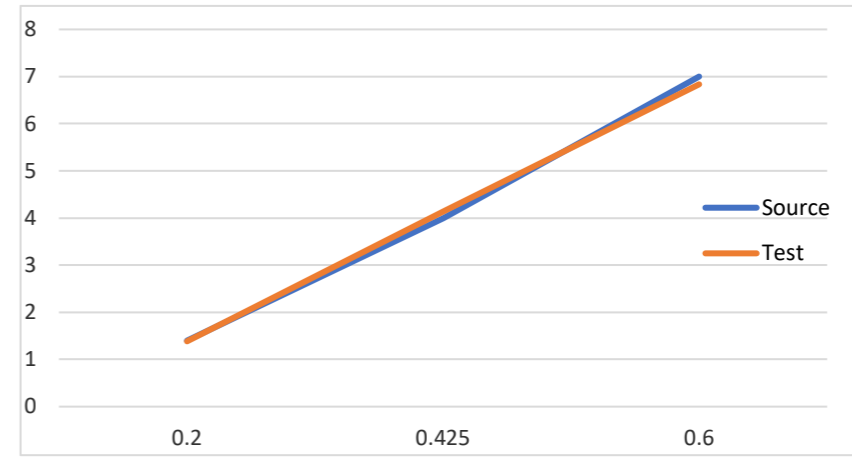

For s = 0.050 (Slope class 50 or greater for Side inlet & Combo) & w=7.0'

| | | | |
|---------|----------|----------|----------|
| LACFCD | | | |
| D | 0.175 | 0.348 | 0.6 |
| x=LN(D) | -1.74297 | -1.05555 | -0.51083 |
| Q | 1.1 | 3.1 | 7.5 |
| y=LN(Q) | 0.09531 | 1.131402 | 2.014903 |
| Test | | | |
| Dt | 0.175 | 0.5 | 1.5 |
| Qt | 1.08808 | 3.172548 | 7.403828 |

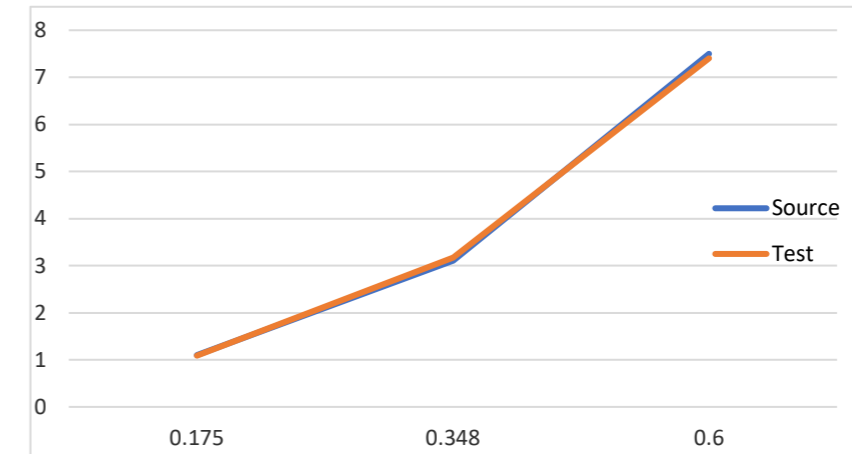

| | | | | | | |
|----------------------|---|------|------------------|---------|------|------|
| 35th Place | | | | | | |
| CBMHB0127 Test | | | | Q10 | Q25 | Q50 |
| | | | | 2.5 | 3.46 | 4.01 |
| Existing | m | D | a (1 grate) | Q=a*D^m | | |
| 1 Grate, 0.1% slope. | | 2.04 | 0.25 | 7.69 | 0.46 | |
| | | | 3 | | | |
| Design Grate | m | D | a (*# of grates) | | | |
| | 6 | 2.04 | 0.25 | 46.14 | 2.74 | |
| | | | 3 | | | |

Flow of Single Bicycle-Proof Grate as standard orifice
 25 1/2"x40" @ 60% Open = 4.25
 With 50% Clogging (Sump) = 2.125

| | | | | | |
|-----|---------|------|---------|-------|--------|
| | Q (cfs) | C0 | Ag (sf) | g | d (ft) |
| 1" | 3.23 | 0.67 | 2.125 | 32.16 | 0.08 |
| 2" | 4.57 | 0.67 | 2.125 | 32.16 | 0.16 |
| 3" | 5.71 | 0.67 | 2.125 | 32.16 | 0.25 |
| 4" | 6.56 | 0.67 | 2.125 | 32.16 | 0.33 |
| 6" | 8.07 | 0.67 | 2.125 | 32.16 | 0.5 |
| 8" | 9.28 | 0.67 | 2.125 | 32.16 | 0.66 |
| 10" | 10.40 | 0.67 | 2.125 | 32.16 | 0.83 |
| 12" | 11.42 | 0.67 | 2.125 | 32.16 | 1 |

| | | | | | | |
|--|---------|-----------|------------|--------------------------------|---------|--------|
| 14th Street | | | | | | |
| CBMHB0127 Test | | | | Q10 | Q25 | Q50 |
| | | | | 28.14 | 35.13 | 40.36 |
| Existing (Modeled) | m | D (ft/in) | a (7 unit) | Q=a*D^m(W/W7)*0.66 | | |
| W=7' | | 1.72 | 0.83 | 14.32 | 6.86 | |
| 33% Clog | | | 9.96 | | | |
| 0% Slope | | | | | | |
| Design (Sump Condition Curve) | | | | Q=4.3AD^0.6*0.5 | | |
| W=21' Max | | | | 8" Normal Curb Face (A = CF*L) | | |
| 50% Clog | | | | Q (cfs) | CF (ft) | L (ft) |
| 0% Slope | | | | W=7 | 7.86 | 0.67 |
| | | | | W=14 | 15.72 | 0.67 |
| | | | | W=21 | 23.58 | 0.67 |
| | | | | | | 7 |
| | | | | | | 14 |
| | | | | | | 21 |
| | | | | | | 0.66 |
| | | | | | | 0.66 |
| | | | | | | 0.66 |
| Number of Additional Grates Needed | | | | Q=C0*Ag(2gd)^1/2 | | |
| Flow of Single Bicycle-Proof Grate as standard orifice | Q (cfs) | C0 | Ag (sf) | g | d (ft) | |
| 25 1/2"x40" @ 60% Open = | 4.25 | 1 G | 9.28 | 0.67 | 2.125 | 32.16 |
| With 50% Clogging (Sump) = | 2.125 | 2 G | 18.55 | 0.67 | 4.25 | 32.16 |
| | | 3 G | 27.83 | 0.67 | 6.375 | 32.16 |
| | | | | | | 0.66 |
| Total Capacity: | Q (cfs) | | | d (in) | | |
| | 42.13 | | | 8 | | |

Flow of Unitized 7' (L) Width Inlet per LACFCD sump condition

| | | | | |
|-----|---------|---------|--------|--------|
| | Q (cfs) | CF (ft) | L (ft) | d (ft) |
| 1" | 4.43 | 0.67 | 7 | 0.08 |
| 2" | 6.72 | 0.67 | 7 | 0.16 |
| 3" | 8.78 | 0.67 | 7 | 0.25 |
| 4" | 10.37 | 0.67 | 7 | 0.33 |
| 6" | 13.31 | 0.67 | 7 | 0.5 |
| 8" | 15.72 | 0.67 | 7 | 0.66 |
| 10" | 18.03 | 0.67 | 7 | 0.83 |
| 12" | 20.17 | 0.67 | 7 | 1 |

| | | | | | | |
|--|---------|-----------|------------|--------------------------|---------|--------|
| Dianthus Street | | | | | | |
| CBPRV0807 Test | | | | Q10 | Q25 | Q50 |
| | | | | 22.25 | 29.68 | 34.13 |
| Existing | m | D (ft/in) | a (7 unit) | Q=a*D^m(W/W7)*0.66 | | |
| W=3.5' | | 1.72 | 0.83 | 14.32 | 3.43 | |
| 33% Clog | | | 9.96 | | | |
| 0% Slope | | | | | | |
| Design (Sump Condition Curve) | | | | Q=4.3AD^0.6*0.5 | | |
| W=7' Max | | | | 10" Curb Face (A = CF*L) | | |
| 50% Clog | | | | Q (cfs) | CF (ft) | L (ft) |
| 0% Slope | | | | W=7 | 9.02 | 0.67 |
| | | | | | | 7 |
| | | | | | | 0.83 |
| Number of Additional Grates Needed | | | | Q=C0*Ag(2gd)^1/2 | | |
| Flow of Single Bicycle-Proof Grate as standard orifice | Q (cfs) | C0 | Ag (sf) | g | d (ft) | |
| 25 1/2"x40" @ 60% Open = | 4.25 | 1 G | 10.40 | 0.67 | 2.125 | 32.16 |
| With 50% Clogging (Sump) = | 2.125 | 2 G | 20.81 | 0.67 | 4.25 | 32.16 |
| | | 3 G | 31.21 | 0.67 | 6.375 | 32.16 |
| | | | | | | 0.83 |
| Total Capacity: | Q (cfs) | | | d (in) | | |
| | 29.82 | | | 8 | | |

| | | | | |
|-----|---------|---------|--------|--------|
| | Q (cfs) | CF (ft) | L (ft) | d (ft) |
| 1" | 5.49 | 0.83 | 7 | 0.08 |
| 2" | 8.32 | 0.83 | 7 | 0.16 |
| 3" | 10.87 | 0.83 | 7 | 0.25 |
| 4" | 12.85 | 0.83 | 7 | 0.33 |
| 6" | 16.48 | 0.83 | 7 | 0.5 |
| 8" | 19.47 | 0.83 | 7 | 0.66 |
| 10" | 22.34 | 0.83 | 7 | 0.83 |
| 12" | 24.98 | 0.83 | 7 | 1 |

| | | | | |
|-----|---------|---------|--------|--------|
| | Q (cfs) | CF (ft) | L (ft) | d (ft) |
| 1" | 6.61 | 1 | 7 | 0.08 |
| 2" | 10.02 | 1 | 7 | 0.16 |
| 3" | 13.10 | 1 | 7 | 0.25 |
| 4" | 15.48 | 1 | 7 | 0.33 |
| 6" | 19.86 | 1 | 7 | 0.5 |
| 8" | 23.46 | 1 | 7 | 0.66 |
| 10" | 26.92 | 1 | 7 | 0.83 |
| 12" | 30.10 | 1 | 7 | 1 |

Table with columns: AGENCY, ADDRESS, INSERT, ASBUILT, NOTES, SIZE (CA), Width, Breadth, AEC_CBID, STD_DRWNG, TYPE, SUBTYPE, No. Grates, CF_H, CMB_Slp_Ft, Is Sump?, Inlet Class, Size Class, Slope Class, Calc Class, %Clogging, D_Low, D_Mid, D_High, QLF_Low, QLF_Mid, QLF_High, Q_Low_G, Q_Mid_G, Q_High_G, QD_Exp, QD_b, QD_Coeff_a

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|---|--------|--------------|----------------|-----------|-------|---------|-----------|-------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| County | 520 Johnson St & 6th St (s/e side on 6th St) | | SD-229_03-38 | | | 7.00 | 3.17 | CBLAC1020 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.030 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| County | 524 N Meadows Ave & 6th St (south side on 6th St) | | SD-162_3-5 | | | 3.50 | 2.13 | CBLAC1021 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.063 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| County | 613 N Valley Dr (west side of Valley) | | SD-239_5-5 | | 7x1.5 | 7.00 | 1.50 | CBLAC1022 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.084 | | S0 | 70 | 80 | S07080 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| County | 1756 6th St (south side) | | #N/A | | | 14.00 | 3.17 | CBLAC1024 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.104 | | S0 | X4 | X1 | S0X4X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| County | 1256 6th St & Meadows Ave (s/w side on Meadows) | | SD-162_3-5 | Slope too high | | 3.00 | 2.83 | CBLAC1025 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.204 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| County | 1256 6th St & Meadows Ave (s/e side on Meadows) | | SD-162_3-5 | | | 3.00 | 2.83 | CBLAC1028 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.080 | | SG | 30 | 80 | SG3080 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.79 | 3.36 | 28.82 |
| County | 501 6th Pl & Ingleside Dr (n/e side on Ingleside) | | SD-239_5-5 | | 3.5x1.5 | 3.50 | 1.50 | CBLAC1030 | AWPA 302-1 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.017 | | SG | 35 | 10 | SG3510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.88 | 2.72 | 15.25 |
| County | 501 6th Pl | | SD-239_5-5 | | 7x1.5 | 7.00 | 1.5 | CBLAC1031 | APWA 305-1 | Catch Basin | Grate | 1.75 | 0.66 | 0.182 | | OG | 70 | X2 | OG70X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.57 | 35.62 |
| County | 441 6th Pl & Ingleside Dr (n/w side on 6th Pl) | | SD-239_5-5 | | 7x1.5 | 7.00 | 1.5 | CBLAC1034 | APWA 305-1 | Catch Basin | Grate | 1.75 | 0.66 | 0.033 | | OG | 70 | 20 | OG7020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.56 | 35.17 |
| County | 1131 5th St (north side) | | SD-229_03-38 | | | 14.00 | 3.17 | CBLAC1043 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.045 | | S0 | X4 | 50 | S0X450 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| County | 1137 5th St (north side) | | SD-229_03-38 | | | 3.50 | 2.13 | CBLAC1044 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.016 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| County | 1751 5th St (north side) | | #N/A | | | 14.00 | 3.17 | CBLAC1046 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.050 | | S0 | X4 | 50 | S0X450 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| County | 1130 5th St (south side) | | SD-229_03-38 | | | 3.50 | 2.13 | CBLAC1047 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.031 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| County | 1751 5th St (south side) | | #N/A | | | 3.50 | 2.13 | CBLAC1048 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.094 | | S0 | 35 | 90 | S03590 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| County | 3rd St & Meadows Ave (n/w side on Meadows) | | SD-162_3-5 | | | 3.00 | 2.83 | CBLAC1060 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.042 | | SG | 30 | 50 | SG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.79 | 3.36 | 28.82 |
| County | 1256 3rd St & Meadows Ave (north side on 3rd St) | | SD-162_3-5 | | | 3.00 | 2.83 | CBLAC1061 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.065 | | SG | 30 | 50 | SG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.79 | 3.36 | 28.82 |
| County | 1757 3rd St (north side) | | #N/A | | | 14.00 | 3.17 | CBLAC1062 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.020 | | S0 | X4 | 30 | S0X430 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.96 | 19.24 |
| County | 501 4th St (east side) | | SD-201_3-5 | | | 3.50 | 2.13 | CBLAC1063 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.015 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| County | 1256 3rd St & Meadows Ave (south side on 3rd St) | | SD-162_3-5 | | | 3.00 | 2.83 | CBLAC1064 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.063 | | SG | 30 | 50 | SG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.79 | 3.36 | 28.82 |
| County | 1757 3rd St (south side) | | #N/A | | | 3.50 | 2.13 | CBLAC1066 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.065 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| County | 200 N/ Meadows Ave & 2nd St (n/e side on Meadow) | | SD-162_3-5 | | | 3.50 | 2.13 | CBLAC1084 | LACFCD CB 1 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.061 | | SG | 35 | 50 | SG3550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.78 | 3.39 | 29.57 |
| County | 200 N/ Meadows Ave & 2nd St (n/w side on Meadow) | | SD-162_3-5 | | | 6.50 | 2.83 | CBLAC1085 | LACFCD CB 6 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.038 | | SG | 65 | 20 | SG6520 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.73 | 3.34 | 28.16 |
| County | 1237 2nd St (north side) | | SD-166_2-2 | | | 3.50 | 2.13 | CBLAC1090 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.021 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| County | 200 N/ Meadows Ave & 2nd St (n/e side on 2nd St) | | SD-189 | | | 6.50 | 2.83 | CBLAC1091 | LACFCD CB 6 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.033 | | SG | 65 | 20 | SG6520 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.73 | 3.34 | 28.16 |
| County | 1743 2nd St (north side) | | #N/A | Slope too high | | 3.00 | 2.00 | CBLAC1095 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.082 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| County | 1237 2nd St (south side) | | SD-166_2-2 | | | 14.00 | 3.17 | CBLAC1097 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.026 | | S0 | X4 | 30 | S0X430 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.96 | 19.24 |
| County | 1560 2nd St (s/w side on 2nd St) | | #N/A | | | 6.50 | 2.83 | CBLAC1098 | LACFCD CB 7 | Catch Basin | Grate and Side | 2.00 | 0.66 | 0.015 | | SG | 65 | 10 | SG6510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.88 | 3.39 | 29.79 |
| County | 1300 2nd St & Meadows Ave (s/e side on 2nd St) | | SD-162_10-20 | | | 3.00 | 2.83 | CBLAC1099 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.076 | | SG | 30 | 80 | SG3080 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.79 | 3.36 | 28.82 |
| County | 1600 2nd St (s/e side on 2nd St) | | #N/A | | | 6.50 | 2.83 | CBLAC1100 | LACFCD CB 7 | Catch Basin | Grate and Side | 2.00 | 0.66 | 0.056 | | SG | 65 | 50 | SG6550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.78 | 4.07 | 58.39 |
| County | 1656 2nd St (s/w side on 2nd St) | | #N/A | | 3x2 | 3.00 | 2 | CBLAC1101 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.097 | | OG | 30 | X1 | OG30X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| County | 1740 2nd St (south side) | | #N/A | Car in way | | 3.00 | 2.83 | CBLAC1102 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.222 | 1.000 | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| County | 1768 2nd St (south side; at V-channel) | | #N/A | | | 3.00 | 2 | CBLAC1104 | LACFCD CB 4 | Catch Basin | Grate | 1.00 | 0.66 | 0.074 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| County | 1768 2nd St (south side) | | #N/A | | | 10.00 | 2 | CBLAC1105 | LACFCD CB 7 | Catch Basin | Grate | 3.33 | 0.66 | 0.037 | | OG | X1 | 20 | OGX120 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 4.20 | 66.98 |
| County | 1560 2nd St (s/w side on Herrin St) | | #N/A | | | 3.00 | 2.83 | CBLAC1106 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.031 | | SG | 30 | 20 | SG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.81 | 3.16 | 23.68 |
| County | 1256 2nd St & 2nd St (s/w side on Meadows) | | SD-162_10-20 | | | 3.00 | 2.83 | CBLAC1108 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.015 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| County | 1656 2nd St (s/w side on Redondo) | | #N/A | | 6.5x2 | 6.50 | 2 | CBLAC1110 | LACFCD CB 7 | Catch Basin | Grate | 2.17 | 0.66 | 0.072 | | OG | 65 | 90 | OG6590 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.79 | 44.10 |
| County | 1300 2nd St & Meadows Ave (s/e side on Meadows) | | SD-162_10-20 | | | 3.50 | 2.13 | CBLAC1111 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.007 | | S0 | 35 | 00 | S03500 | 0.33 | 0.3 | 0.6 | 1 | 1.8 | 6 | 14.25 | 0 | 0 | 0 | 1.72 | 1.57 | 4.80 |
| County | 200 Ingleside Dr & 2nd St (n/e corner on 2nd St) | | SD-222_1-3 | | | 14.00 | 3.17 | CBLAC1114 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.069 | | S0 | X4 | 70 | S0X470 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| County | Aviation Blvd & 1st St e/s in Redondo Beach | | #N/A | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|---------|---|--------------|--------------|----------------------|-----------|-------|---------|-----------|------------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | 554 Rosecrans Ave | | P-695_10-22 | Slope too high | | 7.00 | 3.17 | CBMHB0041 | LACFCD CB 12 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.119 | | S0 | 70 | 10 | S07010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.31 | 10.04 |
| City | El Porto Lot (39th St) | | SD-142 | | | 7.00 | 2 | CBMHB0042 | | Catch Basin | Grate | 2.33 | 0.66 | 0.242 | | 0G | 70 | X2 | 0G70X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.86 | 47.49 |
| City | 3900 The Strand & 39th St (north side on 39th St) | | P-874_SD-03 | | | 10.00 | 2 | CBMHB0043 | | Catch Basin | Grate | 3.33 | 0.66 | 0.205 | | 0G | X1 | X2 | 0GX1X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Rosecrans Ave & Village Dr (s/w of Village Dr) | DEBRIS SCREE | SD-207 | | | 14.00 | 3.17 | CBMHB0044 | LACFCD CB 6 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.026 | | S0 | X4 | 20 | S0X420 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.64 | 3.64 | 38.14 |
| City | 1500 Rosecrans Ave (west of Park Wy on Rosecrans Ave) | | SD-220_2-4 | | | 3.50 | 2.13 | CBMHB0045 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.066 | | S0 | 35 | 70 | S03570 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Lot 4 (38th St & Highland; 2nd level of parking lot) | | D-719A_04-10 | | | 3.00 | 2 | CBMHB0047 | | Inflow | Grate | 1.00 | 0.66 | 0.093 | | 0G | 30 | 90 | 0G3090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | Rosecrans Ave & Aviation Blvd (s/w side on corner) | | SD-249_2-4 | | | 7.00 | 3.17 | CBMHB0048 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.022 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | The Strand | | P-874_SD-03 | | 2x1.5 | 2.00 | 1.50 | CBMHB0049 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.095 | | S0 | 20 | 90 | S02090 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | 1600 Rosecrans Ave & Redondo Ave (east side) | | SD-249_4-4 | Slope too high | | 6.50 | 2.00 | CBMHB0050 | APWA 300-1 | Catch Basin | Grate | 2.17 | 0.66 | 0.106 | | 0G | 65 | 10 | 0G6510 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.11 | 22.33 |
| City | Rosecrans Ave & Aviation Blvd (s/w side on Aviation Blvd) | | SD-249_2-4 | | | 7.00 | 3.17 | CBMHB0053 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.035 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | 1600 Rosecrans Ave & Redondo Ave (west side) | | SD-249_4-4 | | | 14.00 | 3.17 | CBMHB0054 | APWA 300-1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.011 | | S0 | X4 | 10 | S0X410 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 3.00 | 20.08 |
| City | 3616 Laurel Ave | | SD-103_09-14 | | | 3.50 | 2.13 | CBMHB0055 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.059 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 3616 Maple Ave | | SD-203_4-6 | | | 7.00 | 3.17 | CBMHB0056 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.026 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | 3617 Maple Ave | | SD-203_4-6 | | | 7.00 | 3.17 | CBMHB0057 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.101 | | S0 | 70 | X1 | S070X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | Highland Ave & Rosecrans Ave (east side of parkin) | | D-719A_07-10 | Lot 4 Lower Level | 2x1 | 2.00 | 1 | CBMHB0058 | | Inflow | Grate | 0.33 | 0.66 | 0.094 | | 0G | 20 | 90 | 0G2090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 1.91 | 6.78 |
| City | 3615 Laurel Ave | | SD-103_09-14 | | | 7.00 | 3.17 | CBMHB0059 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.018 | | S0 | 70 | 10 | S07010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.31 | 10.04 |
| City | Highland Ave & Rosecrans Ave (east side of parkin) | | D-719A_07-10 | Lot 4 Lower Level | 2x2 | 2.00 | 2 | CBMHB0060 | | Inflow | Grate | 0.67 | 0.66 | 0.066 | | 0G | 20 | 90 | 0G2090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.61 | 13.57 |
| Private | Manhattan Marketplace | | P-821_4-4 | | | xx | xx | CBMHB0061 | | Catch Basin | Grate | 0.00 | 0.66 | 0.057 | | 0G | XX | 50 | 0GXX50 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 0.00 | 0.00 | 0.00 |
| City | 3621 Bell Ave (south side of 36st Pl) | | #N/A | | | 3.00 | 2.00 | CBMHB0062 | | Catch Basin | Grate | 1.00 | 0.66 | 0.024 | | 0G | 30 | 20 | 0G3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | 3612 Palm Ave (east side) | | P-682A_04-14 | | | 7.00 | 3.17 | CBMHB0063 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.078 | | S0 | 70 | 80 | S07080 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 3613 Palm Ave (west side) | | P-682A_04-14 | | | 7.00 | 3.17 | CBMHB0064 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.059 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 3613 Poinsettia Ave (west side) | | P-682A_04-14 | Slope too high | | 3.50 | 3.17 | CBMHB0065 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.219 | 1.000 | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 764 36th Pl | | P-726_42-50 | | | 3.00 | 2 | CBMHB0066 | LACFCD CB 5 | Catch Basin | Grate | 1.00 | 0.66 | 0.055 | | 0G | 30 | 50 | 0G3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | 760 36th Pl | | P-726_42-50 | | | 3.00 | 2 | CBMHB0067 | LACFCD CB 5 | Catch Basin | Grate | 1.00 | 0.66 | 0.042 | | 0G | 30 | 50 | 0G3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | 609 36th St | YES | P-726_44-50 | | | 3.00 | 2 | CBMHB0068 | LACFCD CB 5 | Catch Basin | Grate | 1.00 | 0.66 | 0.107 | | 0G | 30 | X1 | 0G30X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | Highland Ave & Rosecrans Ave (parking lot) | | D-719_04-21 | Lot 4 Lower Level | 2x2 | 2.00 | 2 | CBMHB0069 | Alhambra Foundry | Inflow | Grate | 0.67 | 0.66 | 0.034 | | 0G | 20 | 20 | 0G2020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 2.60 | 13.40 |
| City | Public Works Yard | | D-834_1-1 | | | 7.00 | 2 | CBMHB0071 | | Area Drain | Grate | 2.33 | 0.66 | 0.013 | | 0G | 70 | 10 | 0G7010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.18 | 24.04 |
| City | 3701 Highland Ave (north side on Rosecrans) | | P-695_11-22 | Slope too high ~10% | | 3.50 | 2.00 | CBMHB0072 | LACFCD CB 14 | Inflow | Grate and Side | 1.00 | 0.66 | 0.163 | | SG | 35 | X1 | SG35X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.78 | 3.39 | 29.57 |
| City | Public Works Yard | | SD-254_2-7 | | | 3.00 | 2 | CBMHB0073 | | Catch Basin | Grate | 1.00 | 0.66 | 0.042 | | 0G | 30 | 50 | 0G3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | 316 Rosecrans (south side by El Terasco) | | P-695_11-22 | | | 3.50 | 2.00 | CBMHB0076 | LACFCD CB 14 | Inflow | Grate and Side | 1.00 | 0.66 | 0.011 | | SG | 35 | 10 | SG3510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.88 | 2.72 | 15.25 |
| City | Public Works Yard | | SD-254_2-7 | | | 3.00 | 2 | CBMHB0077 | LACFCD CB 5 | Catch Basin | Grate | 1.00 | 0.66 | 0.047 | | 0G | 30 | 50 | 0G3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | 316 Rosecrans Ave (south side; in front of El Taera) | | P-695_11-22 | | | 3.50 | 2.00 | CBMHB0078 | LACFCD CB 14 | Inflow | Grate and Side | 1.00 | 0.66 | 0.010 | | SG | 35 | 10 | SG3510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.88 | 2.72 | 15.25 |
| City | 3800 The Strand & 38th St | YES | SD-243 | Most flow goes to br | | 1.00 | 1.00 | CBMHB0079 | | Catch Basin | Grate | 0.17 | 0.66 | 0.029 | | 0G | 10 | 20 | 0G1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | The Strand | | P-874_SD-03 | | 2x1.5 | 2.00 | 1.50 | CBMHB0082 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.016 | | S0 | 20 | 10 | S02010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.05 | 2.87 |
| City | El Porto Lot (38th St) | | | | | | | CBMHB0083 | | Inflow | Inflow | 0.00 | 0.66 | 0.072 | | XX | XX | 70 | XXXX70 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | 316 Rosecrans & Crest (west side on Crest) | | P-695_11-22 | | | 3.00 | 2 | CBMHB0084 | LACFCD CB 15 | Inflow | Grate | 1.00 | 0.66 | 0.017 | | 0G | 30 | 10 | 0G3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | Public Works Yard | | D-834_1-1 | | | 3.00 | 2 | CBMHB0086 | | Area Drain | Grate | 1.00 | 0.66 | 0.081 | | 0G | 30 | 90 | 0G3090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | Public Works Yard | | D-834_1-1 | | | 1.00 | 1.00 | CBMHB0088 | | Catch Basin | Grate | 0.17 | 0.66 | 0.024 | | 0G | 10 | 20 | 0G1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | 598 Blanche and 36th St (n/w side) | | W-610_5-8 | | | 7.00 | 3.17 | CBMHB0090 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.138 | | S0 | 70 | X1 | S070X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | Public Works Yard | | D- | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|---|--------------|--------------|--------------------|-----------|-------|---------|----------|-------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | Aviation Blvd & 33rd St (nw corner) | | SD-169_5-6 | Slope too high | | 7.00 | 3.17 | CBMH0176 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.102 | | S0 | 70 | 10 | SG0710 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.31 | 10.04 |
| City | Manhattan Village Soccer Field | | #N/A | | 3x2 | 3.00 | | CBMH0177 | | Catch Basin | Grate | 1.00 | 0.66 | 0.036 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | 3201 Pine Ave (west side) | | W-594_04-11 | | 4.5x4.5 | 4.50 | 4.50 | CBMH0178 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.079 | | S0 | 45 | 80 | S04580 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | 25 Lafayette Ct | | SD-219_16-25 | | 3x2 | 3.00 | | CBMH0179 | LACFCB CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.057 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | 31st Pl (west from Laurel) | | P-726_28-50 | | | 3.00 | | CBMH0180 | LACFCB CB 5 | Inflow | Grate | 1.00 | 0.66 | 0.057 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | 26 San Miguel Ct | | SD-219_15-25 | | 3x2 | 3.00 | | CBMH0181 | LACFCB CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.058 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | The Strand | | P-874_SD-05 | | | 10.00 | | CBMH0182 | | Catch Basin | Grate | 3.33 | 0.66 | 0.054 | | OG | X1 | 50 | OGX150 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.40 | 81.38 |
| City | 5 Lafayette Ct | | SD-219_16-25 | | 3x2 | 3.00 | | CBMH0186 | LACFCB CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.022 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | 30 San Miguel Ct (s/w side of Fairway Dr) | | SD-219_15-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMH0187 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.044 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 3109 Pine Ave (west side) | | SD-186_6-8 | Has Grates & grate | | 3.50 | 2.00 | CBMH0188 | | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.129 | 1.000 | SG | 35 | 10 | SG3510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.88 | 2.72 | 15.25 |
| City | Center of San Miguel Ct | | SD-219_15-25 | | 3x2 | 3.00 | | CBMH0189 | LACFCB CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.034 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | Manhattan Village Soccer Field | | #N/A | | 3x2 | 3.00 | | CBMH0190 | | Catch Basin | Grate | 1.00 | 0.66 | 0.040 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | 30 San Miguel Ct (n/w side of Fairway Dr) | | SD-219_15-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMH0191 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.024 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 3107 N Valley Dr (n/w side) | | W-594_04-11 | | | 7.00 | 3.17 | CBMH0193 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.092 | | S0 | 70 | 90 | S07090 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | The Strand | | P-874_SD-05 | | | 10.00 | | CBMH0194 | | Catch Basin | Grate | 3.33 | 0.66 | 0.134 | | OG | X1 | X1 | OGX1X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Evergreen Ln & Fairway Dr (s/w side on Fairway) | | SD-219_15-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMH0198 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.072 | | S0 | 35 | 70 | SG3570 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Tiburon Ct (north side) | | SD-219_14-25 | | 3x2 | 3.00 | | CBMH0199 | LACFCB CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.177 | | OG | 30 | X2 | OG30X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | 2 San Miguel Ct (n/e side of Fairway Dr) | | SD-219_15-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMH0200 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.098 | | S0 | 35 | X1 | S035X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 3100 Bell Ave & 31st St (n/e side) | DEBRIS SCREE | SD-134_2-8 | | | 7.00 | 3.17 | CBMH0201 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.032 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | 553 31st St (north side) | | SD-134_2-8 | | | 3.50 | 2.13 | CBMH0206 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.038 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 3107 Pine Ave (n/w side on Valley) | | W-594_04-11 | | | 7.00 | 3.17 | CBMH0209 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.023 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | 3101 Pacific Ave (n/w side) | DEBRIS SCREE | SD-103_07-14 | | | 3.50 | 2.13 | CBMH0212 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.136 | | S0 | 35 | X1 | S035X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 3101 Walnut Ave (n/w side on Walnut) | DEBRIS SCREE | SD-235 | | 8x4 | 8.00 | 4.00 | CBMH0213 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.084 | | S0 | 80 | 80 | S08080 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.53 | 12.55 |
| City | 3100 Walnut Ave | | SD-235 | | 7x2 | 7.00 | | CBMH0214 | LACFCB CB 2 | Catch Basin | Grate | 2.33 | 0.66 | 0.055 | | OG | 70 | 50 | OG7050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.04 | 56.97 |
| City | 3100 Maple Ave (east side) | DEBRIS SCREE | SD-203_2-6 | | | 3.50 | 2.13 | CBMH0215 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.012 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 3101 Maple Ave (west side) | DEBRIS SCREE | SD-203_2-6 | | | 3.50 | 2.13 | CBMH0216 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.121 | | S0 | 35 | X1 | S035X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 3100 Pacific Ave (n/e side) | DEBRIS SCREE | SD-103_07-14 | Slope too high | | 3.00 | 2.83 | CBMH0217 | LACFCB CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.109 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| City | 3107 Pine Ave (south side on Valley) | | P-728_31-32 | | | 3.50 | 2.13 | CBMH0218 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.021 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 558 31st St & Bell Ave (south side) | | SD-134_2-8 | | | 3.50 | 2.13 | CBMH0220 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.137 | | S0 | 35 | X1 | S035X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Tiburon Ct (s/w side) | | SD-219_14-25 | | 3x2 | 3.00 | | CBMH0223 | LACFCB CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.196 | | OG | 30 | X2 | OG30X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | 11 Evergreen Ln (west side) | | SD-219_16-25 | | 2x2 | 2.00 | | CBMH0224 | | Catch Basin | Grate | 0.67 | 0.66 | 0.030 | | OG | 20 | 20 | OG2020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 2.60 | 13.40 |
| City | 3101 Walnut Ave (on 31st) | DEBRIS SCREE | SD-186_8-8 | | 8x4 | 8.00 | 4.00 | CBMH0225 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.011 | | S0 | 80 | 10 | S08010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.44 | 11.48 |
| City | 3101 Poinsettia Ave (north side on 31st St) | | SD-186_8-8 | | | 3.50 | 2.13 | CBMH0227 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.028 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 3100 Maple Ave (n/e side on 31st St) | DEBRIS SCREE | SD-203_2-6 | | | 3.50 | 2.13 | CBMH0228 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.091 | | S0 | 35 | 90 | S03590 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 3100 Pacific Ave (n/e side on 31st St) | DEBRIS SCREE | SD-103_07-14 | | | 3.50 | 2.13 | CBMH0229 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.089 | | S0 | 35 | 90 | S03590 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Tiburon Ct & Sausalito Cir (n/w side) | | SD-219_14-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMH0231 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.029 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 3100 Ardmore Ave (west side) | | P-728_31-32 | | | 7.00 | 3.17 | CBMH0232 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.052 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 3100 Walnut Ave (n/w side) | DEBRIS SCREE | SD-186_8-8 | | 8x4 | 8.00 | 4.00 | CBMH0234 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.047 | | S0 | 80 | 50 | S08050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.53 | 12.55 |
| City | 3012 Maple Ave (s/e side on 31st St) | DEBRIS SCREE | SD-186_7-8 | | | 3.50 | 2.13 | CBMH0235 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.065 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0. | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|--|--------------|--------------|-------|-----------|-------|---------|-----------|----------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | 2911 Pacific Ave (west side on Pacific) | | SD-258_5-5 | | | 14.00 | 3.17 | CBMHB0298 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.045 | | S0 | X4 | 50 | S0X450 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| City | 3100 Highland Ave | | SD-247_2-2 | | 7x1.5 | 7.00 | 1.50 | CBMHB0300 | APWA 301 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.025 | | SG | 70 | 20 | SG7020 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.72 | 3.36 | 28.82 |
| City | Monterey Ct (center) | | SD-219_09-25 | | 3x2 | 3.00 | 2 | CBMHB0301 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.017 | | OG | 30 | 10 | OG3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | 3020 Highland Ave (south side) | | SD-247_2-2 | | 7x1.5 | 7.00 | 1.50 | CBMHB0302 | APWA 301 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.029 | | SG | 70 | 20 | SG7020 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.72 | 3.36 | 28.82 |
| City | 23 Westport (west side) | | SD-214_5-7 | | 6.5x2 | 6.50 | 2 | CBMHB0304 | 2GR | Catch Basin | Grate | 2.17 | 0.66 | 0.033 | | OG | 65 | 20 | OG6520 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.77 | 43.54 |
| City | 25 Bridgeport (west side) | | SD-214_5-7 | | 6.5x2 | 6.50 | 2 | CBMHB0306 | 2GR | Catch Basin | Grate | 2.17 | 0.66 | 0.159 | | OG | 65 | X2 | OG65X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.79 | 44.10 |
| City | 600 29th St on Blanche (n/e side) | DEBRIS SCREE | SD-222_3-3 | | | 7.00 | 3.17 | CBMHB0308 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.010 | | S0 | 70 | 10 | S07010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.31 | 10.04 |
| City | 2900 Bell & 29th St (n/e side on Bell) | | #N/A | | | 14.00 | 3.17 | CBMHB0309 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.077 | | S0 | X4 | 80 | S0X480 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| City | Center of Catalina Ct | | SD-219_12-25 | | 3x2 | 3.00 | 2 | CBMHB0313 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.006 | | OG | 30 | 10 | OG3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | 2900 Bell & 29th St (s/e side on 29th St) | | SD-134_2-8 | | | 14.00 | 3.17 | CBMHB0314 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.094 | | S0 | X4 | 90 | S0X490 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| City | 601 29th St on Blanche (s/e side) | | SD-222_3-3 | | | 7.00 | 3.17 | CBMHB0315 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.082 | | S0 | 70 | 80 | S07080 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | Center of Catalina Ct | | SD-219_12-25 | | 3x2 | 3.00 | 2 | CBMHB0316 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.103 | | OG | 30 | X1 | OG30X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | Coronado Ct & Sausalito Cir (n/e side on Sausalito) | | SD-219_10-25 | | 4.5x1.5 | 4.50 | 1.50 | CBMHB0317 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.160 | | S0 | 45 | X2 | S045X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | 29th St & Grandview | | SD-255_2-4 | | 2x2 | 2.00 | 2 | CBMHB0318 | Jensen CB 2424 | Catch Basin | Grate | 0.67 | 0.66 | 0.029 | | OG | 20 | 20 | OG2020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 2.60 | 13.40 |
| City | 2900 Bell & 29th St (s/e side on Bell) | | SD-134_2-8 | | | 3.50 | 2.13 | CBMHB0319 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.056 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Coronado Ct & Sausalito Cir (n/w side on Sausalito) | | SD-219_10-25 | | 4.5x1.5 | 4.50 | 1.50 | CBMHB0320 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.008 | | S0 | 45 | 10 | S04510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.86 | 6.46 |
| City | 2812 Ardmore Ave | | P-728_30-32 | | 8x3.5 | 8.00 | 3.50 | CBMHB0321 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.060 | | S0 | 80 | 50 | S08050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.53 | 12.55 |
| City | 3001 Aviation Blvd; south of 33rd St | | SD-169_3-6 | | | 7.00 | 3.17 | CBMHB0322 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.042 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | Marin Ct (north side) | | SD-219_08-25 | | 3x2 | 3.00 | 2 | CBMHB0323 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.420 | | OG | 30 | XX | OG30XX | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | The Strand | | P-874_SD-06 | | 2x1.5 | 2.00 | 1.50 | CBMHB0324 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.031 | | S0 | 20 | 30 | S02030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.01 | 2.75 |
| City | 2812 Ardmore Ave | | P-728_30-32 | | | 3.50 | 2.13 | CBMHB0325 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.034 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | Marin Ct & Sausalito Cir (east side on Sausalito) | | SD-219_08-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMHB0327 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.093 | | S0 | 35 | 90 | S03590 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Marin Ct & Sausalito Cir (west side on Sausalito) | | SD-219_08-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMHB0328 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.064 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Coronado Ct (west side) | | SD-219_10-25 | | 3x2 | 3.00 | 2 | CBMHB0329 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.438 | | OG | 30 | XX | OG30XX | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | Coronado Ct (center) | | SD-219_10-25 | | 3x2 | 3.00 | 2 | CBMHB0330 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.101 | | OG | 30 | X1 | OG30X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | Village Center Dr & Fairway Dr (n/w on Fairway) | | SD-219_12-25 | | 4.5x1.5 | 4.50 | 1.50 | CBMHB0331 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.033 | | S0 | 45 | 30 | S04530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.82 | 6.19 |
| City | Coronado Ct & Sausalito Cir (s/w side on Sausalito) | | SD-219_10-25 | | 4.5x1.5 | 4.50 | 1.50 | CBMHB0332 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.080 | | S0 | 45 | 80 | S04580 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | Village Center Dr & Fairway Dr (n/w on VillCrDr) | | SD-219_12-25 | | 4.5x1.5 | 4.50 | 1.50 | CBMHB0333 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.066 | | S0 | 45 | 70 | S04570 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | Malaga Wy & Village Center Dr (south side on VillCr) | | SD-219_12-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMHB0335 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.159 | | S0 | 35 | X2 | S035X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Village Center Dr & Fairway Dr (s/w on VillCrDr) | | SD-219_12-25 | | 4.5x1.5 | 4.50 | 1.50 | CBMHB0336 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.260 | | S0 | 45 | XX | S045XX | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | Marin Ct (south side) | | SD-219_08-25 | | 3x2 | 3.00 | 2 | CBMHB0337 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.309 | | OG | 30 | XX | OG30XX | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | Village Center Dr & Gateway Dr (north side) | | SD-219_11-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMHB0340 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.109 | | S0 | 35 | X1 | S035X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Village Center Dr & Gateway Dr (s/w side) | | SD-219_11-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMHB0342 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.267 | | S0 | 35 | XX | S035XX | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 601 27th St on Blanche | YES | P-746_12-14 | | | 3.50 | 2.13 | CBMHB0343 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.003 | 1 | S0 | 35 | 00 | S03500 | 0.33 | 0.3 | 0.6 | 1 | 1.8 | 6 | 14.25 | 0 | 0 | 0 | 1.72 | 1.57 | 4.80 |
| City | Village Center Dr & Gateway Dr (s/e side) | | SD-219_11-25 | | 3.5x3.5 | 3.50 | 3.50 | CBMHB0344 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.107 | | S0 | 35 | X1 | S035X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Cayman Ct & Sausalito Cir (n/w side on Sausalito) | | SD-219_05-25 | | 4.5x1.5 | 4.50 | 1.50 | CBMHB0345 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.102 | | S0 | 45 | X1 | S045X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | Village Cir & Village Center Dr (n/e side) | | SD-214_2-7 | | 8x4 | 8.00 | 4.00 | CBMHB0346 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.041 | | S0 | 80 | 50 | S08050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.53 | 12.55 |
| City | Village Cir & Village Center Dr (s/w side) | | SD-214_2-7 | | 8x4 | 8.00 | 4.00 | CBMHB0347 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.143 | | S0 | 80 | X1 | S080X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.53 | 12.55 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRAWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|---|-------------------|--------------|------------------------|-----------|-------|---------|----------|----------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | Marine Ave Park | | M-885_003 | | 1x1 | 1.00 | 1 | CBMH0407 | Brooks CB 1212 | Area Drain | Grate | 0.17 | 0.66 | 0.022 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Marine Ave Park | | M-885_003 | | | 3.00 | 2 | CBMH0409 | LACFCB CB 5 | Area Drain | Grate | 1.00 | 0.66 | 0.004 | 1 | OG | 30 | 10 | OG3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | Gateway Dr & Marine Ave (east side on Gateway) | | #N/A | | 8x4 | 8.00 | 4.00 | CBMH0415 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.018 | | SO | 80 | 10 | S08010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.44 | 11.48 |
| City | Gateway Dr & Marine Ave (west side on Gateway) | | #N/A | | 8x4 | 8.00 | 4.00 | CBMH0416 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.018 | | SO | 80 | 10 | S08010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.44 | 11.48 |
| City | 1701 Marine Ave (s/e side of parking lot) | | NO DRAWING | French Drain? Per J | 4x2 | 4.00 | 2 | CBMH0417 | | Inflow | Grate | 1.33 | 0.66 | 0.053 | | OG | 40 | 50 | OG4050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.48 | 32.55 |
| City | 2301 Marine & Aviation (n/w side) | wrong asbuilt (tc | SD-169_2-6 | | | 7.00 | 3.17 | CBMH0418 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.048 | | SO | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | Marine Ave Park & Herrin Ave (north side in Park) | | M-885_003 | | | 1.00 | 1.00 | CBMH0419 | LACFCB CB 5 | Catch Basin | Grate | 0.17 | 0.66 | 0.039 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | 2401 Blanche & 25th St (west side outlet) | Could be Spec'd | SD-144_2-4 | Slope too high | | 3.50 | 3.17 | CBMH0421 | LACFCB CB 5A | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.094 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | Marine Ave & Redondo Ave (east side on Redondo | | NO DRAWING | | | 3.50 | 3.17 | CBMH0423 | | Inflow | Side Inlet | 0.00 | 0.66 | 0.040 | | SO | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Gateway Dr & Marine Ave (north side on Marine) | | #N/A | | 4.5x4.5 | 4.50 | 4.50 | CBMH0425 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.120 | | SO | 45 | X1 | S045X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | 2400 Blanche & 24th St (n/e side on 24th St) | | SD-186_2-8 | | 8x4 | 8.00 | 4.00 | CBMH0426 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.044 | | SO | 80 | 50 | S08050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.53 | 12.55 |
| City | 835 Marine Ave | | W-580_24-40 | | | 3.50 | 3.17 | CBMH0427 | | Inflow | Side Inlet | 0.00 | 0.66 | 0.046 | | SO | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 2400 Blanche & 24th St (s/e side on Blanche) | | SD-186_2-8 | | | 7.00 | 3.17 | CBMH0429 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.091 | | SO | 70 | 90 | S07090 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 2417 John St | | W-580_24-40 | Shallow 4" inlet | | 3.00 | 3.17 | CBMH0430 | LACFCB CB 38 | Inflow | Side Inlet | 0.00 | 0.66 | 0.100 | | SO | 30 | 10 | S03010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.46 | 4.30 |
| City | The Strand | | P-874_SD-07 | | 2x1.5 | 2.00 | 1.50 | CBMH0432 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.025 | | SO | 20 | 30 | S02030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.01 | 2.75 |
| City | 2400 Blanche & 24th St (n/w side on 24th St) | | SD-186_2-8 | | 3x2 | 3.00 | 2.00 | CBMH0433 | LACFCB CB 6 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.007 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| City | 2519 Crest Dr | Small 24"x4" He | SD-231 | | | 1.00 | 0.33 | CBMH0434 | | Inflow | Side Inlet | 0.00 | 0.66 | 0.031 | | SO | XX | 30 | S0XX30 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 0.32 | 1.37 |
| City | 2412 Poinsettia Ave (east side) | | P-588-001 | Slope too high | | 3.50 | 3.17 | CBMH0435 | | Inflow | Side Inlet | 0.00 | 0.66 | 0.193 | 1.000 | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 2515 Alma Ave | | SD-255_3-4 | | 7x3.5 | 7.00 | 3.50 | CBMH0436 | APWA 300-2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.160 | | SO | 70 | X2 | S070X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 2317 Blanche Rd | | | Slope too high | | 3.50 | 3.17 | CBMH0437 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.075 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | Marine & Aviation (s/w side) | DEBRIS SCREE | SD-133_05-10 | | | 7.00 | 3.17 | CBMH0438 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.043 | | SO | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 233 25th Pl (west side) | | SD-250_3-4 | | 7x5 | 7.00 | 5.00 | CBMH0442 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.150 | | SO | 70 | X1 | S070X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 2505 Crest Dr | | SD-251 | Private in front of Dr | xx | xx | | CBMH0443 | APWA 300-2 | Catch Basin | Grate | 0.00 | 0.66 | 0.021 | | OG | XX | 20 | OGXX20 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 0.00 | 0.00 | 0.00 |
| City | Aviation south of Marine (west side) | DEBRIS SCREE | SD-133_06-10 | | | 14.00 | 3.17 | CBMH0444 | LACFCB CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.014 | | SO | X4 | 10 | S0X410 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 3.00 | 20.08 |
| City | 26th St & Bayview Dr (s/w side) | | SD-250_3-4 | | 6x1.5 | 6.00 | 1.5 | CBMH0445 | APWA 301 | Catch Basin | Grate | 1.50 | 0.66 | 0.015 | | OG | 60 | 10 | OG6010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.74 | 15.46 |
| City | 2508 Highland Ave (east side) | | NO DRAWING | Car in way | | 3.50 | 3.17 | CBMH0446 | | Outflow | Side Inlet | 0.00 | 0.66 | 0.012 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 656 Marine on Flournoy | | SD-061_1-2 | Slope too high | | 3.50 | 3.17 | CBMH0447 | LACFCB CB 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.073 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 26th St & Manhattan Ave (n/e side) | | SD-250_3-4 | | 14x1.5 | 14.00 | 1.50 | CBMH0448 | APWA 301 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.023 | | SG | X4 | 20 | SGX420 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.64 | 3.64 | 38.14 |
| City | 29th St & Grandview Ave | | SD-255_3-4 | | | 3.50 | 3.17 | CBMH0449 | APWA 300-0 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.024 | | SO | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 549 23rd St & Blanche (n/w corner) | | SD-186_3-8 | | 3x2 | 3.00 | 2.00 | CBMH0452 | LACFCB CB 6 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.073 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| City | 2507 Highland Ave (west side) | | SD-250_3-4 | | 7x5 | 7.00 | 5.00 | CBMH0453 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.039 | | SO | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | 2209 Wendy Way | | P-511_005 | Slope too high | | 3.50 | 3.17 | CBMH0454 | 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.074 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 2300 Blanche Rd & 23rd St (s/e side on Blanche) | | SD-186_3-8 | | | 3.50 | 2.13 | CBMH0455 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.133 | | SO | 35 | X1 | S035X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 2501 Crest Dr (s/w side) | DEBRIS SCREE | SD-237_2-2 | | | 3.50 | 3.17 | CBMH0457 | APWA 300-0 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.019 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 1467 23rd St (n/w side on Peck) | | #N/A | | | 7.00 | 3.17 | CBMH0458 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.048 | | SO | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 2221 Blanche Rd | | | Slope too high | | 3.50 | 3.17 | CBMH0460 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.147 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 2509 Bayview & 25th Pl | | SD-250_3-4 | | 3x2 | 3.00 | 2 | CBMH0461 | LACFCB CB 6 | Catch Basin | Grate | 1.00 | 0.66 | 0.212 | | OG | 30 | X2 | OG30X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| City | 2500 Highland Ave (east side) | | SD-250_3-4 | | 7x5 | 7.00 | 5.00 | CBMH0463 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.122 | | SO | 70 | X1 | S070X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 1501 23rd St (north side btwn 1501 & 1507) | | #N/A | 9 Grts per GE | | 14.00 | 2.00 | CBMH0465 | LACFCB CB 3 | Catch Basin | Grate | 4.67 | 0.66 | 0.062 | | OG | X4 | 50 | OGX450 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.74 | 113.93 |
| City | 2209 Wendy Way | | P-511_005 | Slope too high | | 3.50 | 3.17 | CBMH0466 | 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.083 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 1500 23rd St (south side) | | #N/A | | | 3.50 | 2.13 | CBMH0467 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.047 | | SO | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Flournoy & Valley (Vetrans Park; before green belt) | | SD-194_2-2 | | | 10.00 | 2 | CBMH0468 | LACFCB CB 7 | Catch Basin | Grate | 3.33 | 0.66 | 0.095 | | OG | X1 | 90 | OGX190 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | 1466 23rd St (s/w side on Peck) | | #N/A | | | 7.00 | 3.17 | CBMH0469 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.029 | | SO | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | 1500 23rd St (s/e side on Peck) | | #N/A | | | 7.00 | 3.17 | CBMH0470 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.019 | | SO | 70 | 10 | S07010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.31 | 10.04 |
| City | The | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|---|--------------|-------------|-----------------------|-----------|-------|---------|-----------|--------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | 1900 N Sepulveda Blvd (east side; Dry Cleaners) | | SD-134_5-8 | | 3x2 | 3.00 | 2.00 | CBMHB0520 | LACFCB CB 2 | Catch Basin | Grate | 1.00 | 0.66 | 0.025 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | The Strand | | P-874_SD-08 | | 2x1.5 | 2.00 | 1.50 | CBMHB0521 | LACFCB CB 39 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.125 | | SO | 20 | X1 | S020X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | 1829 Poinsettia on 19th St | | SD-058 | | | 7.00 | 3.17 | CBMHB0522 | LACFCB CB 39 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.028 | | SO | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | 1829 Elm & 19th St (s/e side on 19th St) | DEBRIS SCREE | SD-134_5-8 | | | 3.50 | 2.13 | CBMHB0523 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.074 | | SO | 35 | 70 | S03570 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 1829 Elm & 19th St (s/w side on 19th St) | DEBRIS SCREE | SD-134_5-8 | | 4.5x4 | 4.50 | 4.00 | CBMHB0524 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.043 | | SO | 45 | 50 | S04550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| City | 1900 Oak & 19th St (s/e side on 19th St) | | SD-134_5-8 | | | 3.50 | 2.13 | CBMHB0525 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.037 | | SO | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 1828 Elm & 19th St (s/e side on Elm) | DEBRIS SCREE | SD-134_5-8 | | | 3.50 | 2.13 | CBMHB0526 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.353 | | SO | 35 | XX | S035XX | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 1829 Sepulveda Blvd | | SD-134_5-8 | | 3x2 | 3.00 | 2.00 | CBMHB0527 | LACFCB CB 2 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.056 | | SG | 30 | 50 | SG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.79 | 3.36 | 28.82 |
| City | 1900 Oak & 19th St (s/w side on Oak) | | SD-134_5-8 | | 12x4 | 12.00 | 4.00 | CBMHB0528 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.029 | | SO | X2 | 30 | S0X230 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.80 | 16.49 |
| City | 1900 Oak & 19th St (s/e side on Oak) | | SD-134_5-8 | | | 7.00 | 3.17 | CBMHB0529 | LACFCB CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.057 | | SO | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 1825 POINSETTIA AVE | | | | | 3.00 | 2 | CBMHB0530 | | Catch Basin | Grate | 1.00 | 0.66 | 0.051 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | Aviation north of 19th St (west side) | P-511_004 | | Slope too high | | 3.50 | 3.17 | CBMHB0531 | 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.147 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 1830 N Sepulveda Blvd (east side) | | SD-134_5-8 | | 10x2 | 10.00 | 2.00 | CBMHB0532 | LACFCB CB 2 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.040 | | SG | X1 | 50 | SGX150 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.71 | 3.68 | 39.47 |
| City | 1901 Lynngrove Dr (n/e side cr of 19th & Redondo) | #N/A | | Slope too high | | 3.50 | 3.17 | CBMHB0534 | LACFCB CB 5 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.067 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 1311 19th St | #N/A | | | 6x2 | 6.00 | 2.00 | CBMHB0535 | APWA 300-1 | Inflow | Side Inlet | 0.00 | 0.66 | 0.109 | | SO | 60 | X1 | S060X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.24 | 9.41 |
| City | 1561 19th St | #N/A | | | | 14.00 | 3.17 | CBMHB0536 | LACFCB CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.099 | | SO | X4 | X1 | S0X4X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| City | 1650 19th St (s/w side) | #N/A | | | 7x4.5 | 7.00 | 4.50 | CBMHB0537 | P-528_006 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.208 | | SO | 70 | X2 | S070X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 1813 Lynngrove Dr (s/e side cr of 19th & Redondo) | #N/A | | Slope too high | | 3.50 | 3.17 | CBMHB0538 | LACFCB CB 5 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.101 | | SO | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 1821 Herrin St | #N/A | | | | 14.00 | 3.17 | CBMHB0539 | LACFCB CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.100 | | SO | X4 | X1 | S0X4X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 3.09 | 21.96 |
| City | 2212 The Strand (near bike path) | P-134 | | | | 7.00 | 2 | CBMHB0540 | | Catch Basin | Grate | 2.33 | 0.66 | 0.044 | | OG | 70 | 50 | OG7050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.04 | 56.97 |
| City | 2104 Highland Ave (east side) | | SD-253_4-8 | | 7x2.5 | 7.00 | 2.50 | CBMHB0541 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.062 | | SO | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 728 18th St & Agnes Rd (south side) | P-588-012 | | | | 14.00 | 2.00 | CBMHB0542 | LACFCB CB 37 | Inflow | Grate | 4.67 | 0.66 | 0.077 | | OG | X4 | 90 | OGX490 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.55 | 94.98 |
| City | 2120 The Strand | | | | | | | CBMHB0545 | | Inflow | Inflow | 0.00 | 0.66 | 0.024 | | XX | XX | 30 | XXXXX30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 2020 Highland Ave (south side) | | SD-253_4-8 | | 7x2.5 | 7.00 | 2.50 | CBMHB0546 | APWA 307 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.017 | | SG | 70 | 10 | SG7010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.81 | 3.01 | 20.24 |
| City | 1600 18th St (on south side of Herrin) | #N/A | | | | 3.50 | 2.13 | CBMHB0547 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.032 | | SO | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 1725 Pacific Ave | P-588-013 | | | 3x1.5 | 3.00 | 1.50 | CBMHB0548 | LACFCB CB 38 | Inflow | Side Inlet | 0.00 | 0.66 | 0.051 | | SO | 30 | 50 | S03050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.55 | 4.71 |
| City | 1724 Pacific Ave | P-552 | | | 3x1.5 | 3.00 | 1.50 | CBMHB0549 | LACFCB CB 38 | Inflow | Side Inlet | 0.00 | 0.66 | 0.015 | | SO | 30 | 10 | S03010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.46 | 4.30 |
| City | 1600 18th St (on south side of Herrin) | #N/A | | | | 3.50 | 2.13 | CBMHB0552 | LACFCB CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.028 | | SO | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 2012 Highland Ave (east side on 20th Pl) | | SD-253_4-8 | | 12x2 | 12.00 | 2 | CBMHB0553 | APWA 305 | Catch Basin | Grate | 4.00 | 0.66 | 0.025 | | OG | X2 | 20 | OGX220 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 4.39 | 80.38 |
| City | 423 19th Pl | P-878_001 | | | | 3.00 | 2.00 | CBMHB0555 | | Inflow | Grate | 1.00 | 0.66 | 0.038 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | 301 20th St (n/e side) | | SD-253_4-8 | | 7x2.5 | 7.00 | 2.50 | CBMHB0559 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.020 | | SO | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | The Strand | #N/A | | | 2x1.5 | 2.00 | 1.50 | CBMHB0560 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.040 | | SO | 20 | 50 | S02050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | 233 20th St (n/w side) | | SD-253_4-8 | | 7x2.5 | 7.00 | 2.50 | CBMHB0561 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.023 | | SO | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | east end 19th St @ top of Live Oak Park | NO DRAWING | | Need field location c | | 1.00 | 1.00 | CBMHB0563 | | Inflow | Grate | 0.17 | 0.66 | 0.027 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | 705 17th St (at cul-de-sac) | | SD-057 | | | 14.00 | 3.17 | CBMHB0564 | LACFCB CB 3 | Inflow | Side Inlet | 0.00 | 0.66 | 0.015 | | SO | X4 | 10 | S0X410 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 3.00 | 20.08 |
| City | The Strand | P-874_SD-09 | | | 2x1.5 | 2.00 | 1.50 | CBMHB0566 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.010 | | SO | 20 | 10 | S02010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.05 | 2.87 |
| City | Begg School | #N/A | | | | 14.00 | 2.00 | CBMHB0567 | | Inflow | Grate | 4.67 | 0.66 | 0.012 | | OG | X4 | 10 | OGX410 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.87 | 48.09 |
| City | 117 20th Pl | | SD-253_3-8 | | 6x2.5 | 6.00 | 2.5 | CBMHB0568 | APWA 305 | Catch Basin | Grate | 2.50 | 0.66 | 0.044 | | OG | 60 | 50 | OG6050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.11 | 61.04 |
| City | Cul-de-sac of Herrin St & Polliwog park | #N/A | | | | 10.00 | 2 | CBMHB0569 | | Catch Basin | Grate | 3.33 | 0.66 | 0.018 | | OG | X1 | 10 | OGX110 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.54 | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|-----------------------------------|--------------|-------------|------------|-----------|-------|---------|-----------|------------------|-------------|-------------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | Joslyn Center parking lot | | #N/A | | | 10.00 | 2 | CBMHB0634 | | Inflow | Grate | 3.33 | 0.66 | 0.010 | | 0G | X1 | 10 | 0GX110 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.54 | 34.35 |
| City | 1500 Ardmore (west side) | | W-597_2-3 | | | 14.00 | 3.17 | CBMHB0635 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.025 | | S0 | X4 | 30 | S0X430 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.96 | 19.24 |
| City | Ocean Dr & 17th Pl | | #N/A | | 6.5x3 | 6.50 | 3 | CBMHB0636 | APWA 305 | Catch Basin | Grate | 3.25 | 0.66 | 0.009 | | 0G | 65 | 10 | 0G6510 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.51 | 33.49 |
| City | 1613 Highland Ave | | SD-258_4-5 | | 7x4 | 7.00 | 4.00 | CBMHB0637 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.004 | 1 | S0 | 70 | 00 | S07000 | 0.33 | 0.3 | 0.6 | 1 | 1.8 | 6 | 14.25 | 0 | 0 | 0 | 1.72 | 2.26 | 9.59 |
| City | City Hall Annex parking lot | | D-790_2 | | | 7.00 | 2 | CBMHB0639 | Brooks 2424L18 C | Inflow | Grate | 2.33 | 0.66 | 0.121 | | 0G | 70 | X1 | 0G70X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.86 | 47.49 |
| City | e/s Highland Ave @ 16th Pl | | SD-258_4-5 | | 6.5x6 | 6.50 | 6 | CBMHB0643 | APWA 305 | Catch Basin | Grate | 6.50 | 0.66 | 0.024 | | 0G | 65 | 20 | 0G6520 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 4.87 | 130.62 |
| City | 1428 Ardmore (15th St s/e corner) | | W-597_2-3 | | | 3.00 | 2.83 | CBMHB0646 | LACFCD CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.013 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| City | w/s Highland Ave s/o 16th Pl | | SD-258_4-5 | | 3.5x4 | 3.50 | 4.00 | CBMHB0648 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.013 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0649 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.024 | | XX | 10 | 30 | XX1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Ocean Dr & 17th St | | SD-258_2-5 | | 7x4 | 7.00 | 4.00 | CBMHB0650 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.026 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0651 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.041 | | XX | 10 | 50 | XX1050 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | MBUSD Yard | | #N/A | | | 7.00 | 2 | CBMHB0652 | | Inflow | Grate | 2.33 | 0.66 | 0.046 | | 0G | 70 | 50 | 0G7050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.04 | 56.97 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0653 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.047 | | XX | 10 | 50 | XX1050 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0654 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.014 | | XX | 10 | 10 | XX1010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0655 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.022 | | XX | 10 | 30 | XX1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | The Strand | | P-874_SD-11 | | 2x1.5 | 2.00 | 1.5 | CBMHB0656 | | Catch Basin | Grate | 0.50 | 0.66 | 0.030 | | 0G | 20 | 20 | 0G2020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 2.31 | 10.05 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0657 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.028 | | XX | 10 | 30 | XX1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Valley Dr s/o 15th St w/s | | P-876_006 | | | 7.00 | 3.17 | CBMHB0658 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.020 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | Civic Center (15th St) | | #N/A | | 8x1 | 8.00 | 1 | CBMHB0659 | | Inflow | Grate | 1.33 | 0.66 | 0.129 | | 0G | 80 | X1 | 0G80X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.30 | 27.14 |
| City | Valley Dr s/o 15th St e/s | Faces Median | W-597_2-3 | | | 7.00 | 3.17 | CBMHB0660 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.035 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0661 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.044 | | XX | 10 | 50 | XX1050 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0662 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.023 | | XX | 10 | 30 | XX1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | 115 16th Pl | | SD-258_2-5 | | 6.5x3.5 | 6.50 | 3.5 | CBMHB0665 | APWA 305 | Catch Basin | Grate | 3.79 | 0.66 | 0.048 | | 0G | 65 | 50 | 0G6550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.53 | 92.57 |
| City | Civic Center | | D-879_P201 | Area Drain | | 10.00 | 2 | CBMHB0666 | | Area Drain | Grate | 3.33 | 0.66 | 0.055 | | 0G | X1 | 50 | 0GX150 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.40 | 81.38 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0667 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.030 | | XX | 10 | 30 | XX1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | w/s Highland Ave n/o 15th Pl | | SD-258_4-5 | | 7x4 | 7.00 | 4.00 | CBMHB0668 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.007 | | S0 | 70 | 00 | S07000 | 0.33 | 0.3 | 0.6 | 1 | 1.8 | 6 | 14.25 | 0 | 0 | 0 | 1.72 | 2.26 | 9.59 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0669 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.024 | | XX | 10 | 30 | XX1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | The Strand | | P-874_SD-11 | | 12" | 1.00 | | CBMHB0671 | | Cleanout | Cleanout | 0.00 | 0.66 | 0.057 | | NA | NA | 60 | NANA60 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | 1508 Highland Ave | | SD-258_4-5 | | 6.5x6 | 6.50 | 6 | CBMHB0672 | APWA 305 | Catch Basin | Grate | 6.50 | 0.66 | 0.030 | | 0G | 65 | 20 | 0G6520 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 4.87 | 130.62 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0673 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.026 | | XX | 10 | 30 | XX1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P201 | Area Drain | | 10.00 | 2 | CBMHB0674 | | Area Drain | Grate | 3.33 | 0.66 | 0.316 | | 0G | X1 | XX | 0GX1XX | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Civic Center | | D-879_P209 | Area Drain | | | | CBMHB0675 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.149 | | XX | XX | X1 | XXXXX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Polliwog Park | | #N/A | | 1x1 | 1.00 | 1.00 | CBMHB0676 | NDS 1200 | Inflow | Subterranean Drai | 0.00 | 0.66 | 0.079 | | XX | 10 | 80 | XX1080 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P209 | Area Drain | | | | CBMHB0677 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.029 | | XX | XX | 30 | XXXXX30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P209 | Area Drain | | | | CBMHB0678 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.058 | | XX | XX | 60 | XXXXX60 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | w/s Highland Ave s/o 15th Pl | | SD-258_4-5 | | 3.5x4 | 3.50 | 4.00 | CBMHB0680 | APWA 300 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.013 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | Civic Center (15th St) | | D-879_C300 | | 4" | 0.33 | | CBMHB0681 | NDS | Inflow | Grate | 0.09 | 0.66 | 0.025 | | 0G | 04 | 20 | 0G0420 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 0.54 | 1.72 |
| City | Civic Center | | D-879_P209 | Area Drain | | 1.00 | 1.00 | CBMHB0682 | | Area Drain | Grate | 0.17 | 0.66 | 0.022 | | 0G | 10 | 20 | 0G1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Civic Center (15th St) | | D-879_C300 | | 4" | 0.33 | | CBMHB0683 | NDS | Inflow | Grate | 0.09 | 0.66 | 0.043 | | 0G | 04 | 50 | 0G0450 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 0.74 | 2.09 |
| City | Civic Center | | D-879_P209 | Area Drain | | | | CBMHB0685 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.118 | | XX | XX | X1 | XXXXX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P209 | Area Drain | | 10.00 | 2 | CBMHB0686 | | Area Drain | Grate | 3.33 | 0.66 | 0.078 | | 0G | X1 | 90 | 0GX190 | 0. | | | | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|-------------------------------|--------|---------------|------------|-----------|-------|---------|-----------|----------------|-------------|-------------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|-------|------------|
| City | Civic Center (Highland) | | D-687_72-89 | | | 10.00 | 2 | CBMHB0742 | | Inflow | Grate | 3.33 | 0.66 | 0.109 | | OG | X1 | X1 | OGX1X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | 1200 MBB Center | | P-842_2-6 | | | 3.50 | 3.17 | CBMHB0743 | APWA 300-1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.031 | | S0 | 35 | X0 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | Civic Center | | D-879_P210 | Area Drain | | 10.00 | 2 | CBMHB0744 | | Area Drain | Grate | 3.33 | 0.66 | 0.373 | | OG | X1 | XX | OGX1XX | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Civic Center | | D-879_C300 | Area Drain | 4" | 0.33 | | CBMHB0746 | NDS | Area Drain | Grate | 0.09 | 0.66 | 0.042 | | OG | 04 | 50 | OG0450 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 0.74 | 2.09 |
| City | Civic Center | | #N/A | Area Drain | 4" | 0.33 | | CBMHB0747 | NDS | Area Drain | Grate | 0.09 | 0.66 | 0.117 | | OG | 04 | X1 | OG04X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 0.55 | 1.74 |
| City | Civic Center | | D-879_C300 | Area Drain | 4" | 0.33 | | CBMHB0748 | NDS | Area Drain | Grate | 0.09 | 0.66 | 0.131 | | OG | 04 | X1 | OG04X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 0.55 | 1.74 |
| City | City Hall parking lot | | W-597_2-3 | | | 1.50 | 1.5 | CBMHB0749 | Jensen CB 1616 | Catch Basin | Grate | 0.38 | 0.66 | 0.059 | | OG | 15 | 50 | OG1550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 2.21 | 9.16 |
| City | Civic Center | | D-879_C300 | Area Drain | 4" | 0.33 | | CBMHB0750 | NDS | Area Drain | Grate | 0.09 | 0.66 | 0.208 | | OG | 04 | X2 | OG04X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 0.55 | 1.74 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0751 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.026 | | XX | XX | X0 | XXXXX30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_C300 | Area Drain | 1.5x1.5 | 1.50 | 1.5 | CBMHB0754 | Jensen CB 1616 | Area Drain | Grate | 0.38 | 0.66 | 0.116 | | OG | 15 | X1 | OG15X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.03 | 7.63 |
| City | Civic Center | | D-879_P210 | Area Drain | | 1.00 | 1.00 | CBMHB0755 | | Area Drain | Grate | 0.17 | 0.66 | 0.036 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Civic Center | | D-879_C300 | Area Drain | 1.5x1.5 | 1.50 | 1.5 | CBMHB0758 | Jensen CB 1616 | Area Drain | Grate | 0.38 | 0.66 | 0.007 | | OG | 15 | 10 | OG1510 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 1.35 | 3.86 |
| City | Civic Center | | D-879_P210 | Area Drain | | 10.00 | 2 | CBMHB0759 | | Area Drain | Grate | 3.33 | 0.66 | 0.010 | | OG | X1 | 10 | OGX110 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.54 | 34.35 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0760 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.036 | | XX | XX | 30 | XXXXX30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0761 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.121 | | XX | XX | X1 | XXXXX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_C300 | Area Drain | 4" | 0.33 | | CBMHB0762 | NDS | Area Drain | Grate | 0.09 | 0.66 | 0.090 | | OG | 04 | 90 | OG0490 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 0.55 | 1.74 |
| City | Civic Center | | D-879_C300 | Area Drain | | 10.00 | 2 | CBMHB0763 | | Area Drain | Grate | 3.33 | 0.66 | 0.053 | | OG | X1 | 50 | OGX150 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.40 | 81.38 |
| City | Civic Center | | D-879_P210 | Area Drain | | 10.00 | 2 | CBMHB0764 | | Area Drain | Grate | 3.33 | 0.66 | 0.115 | | OG | X1 | X1 | OGX1X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0765 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.069 | | XX | XX | 70 | XXXXX70 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P210 | Area Drain | | 1.00 | 1.00 | CBMHB0766 | | Area Drain | Grate | 0.17 | 0.66 | 0.028 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Civic Center | | D-879_C300 | Area Drain | .5x.5 | 0.50 | 0.5 | CBMHB0767 | Zurn Z-415 | Area Drain | Grate | 0.04 | 0.66 | 0.107 | | OG | 05 | X1 | OG05X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | -0.16 | 0.85 |
| City | 1140 MBB (south side of MBB) | | P-842_2-6 | | | 3.50 | 3.17 | CBMHB0768 | APWA 300-1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.049 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Civic Center | | D-879_C300 | Area Drain | | 1.50 | 1.5 | CBMHB0769 | Jensen CB 1616 | Area Drain | Grate | 0.38 | 0.66 | 0.069 | | OG | 15 | 90 | OG1590 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.03 | 7.63 |
| City | Civic Center | | D-879_P210 | Area Drain | | 10.00 | 2 | CBMHB0770 | | Area Drain | Grate | 3.33 | 0.66 | 0.013 | | OG | X1 | 10 | OGX110 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.54 | 34.35 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0771 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.121 | | XX | XX | X1 | XXXXX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | 1401 Highland Ave (west side) | | P-803_019-117 | | 2x2 | 2.00 | 2 | CBMHB0773 | LACFCB CB 2 | Inflow | Grate | 0.67 | 0.66 | 0.167 | | OG | 20 | X2 | OG20X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.61 | 13.57 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0774 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.048 | | XX | XX | 50 | XXXXX50 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0775 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.093 | | XX | XX | 90 | XXXXX90 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_C300 | Area Drain | 4" | 0.33 | | CBMHB0776 | NDS | Area Drain | Grate | 0.09 | 0.66 | 0.053 | | OG | 04 | 50 | OG0450 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 0.74 | 2.09 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0777 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.176 | | XX | XX | X2 | XXXXX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_C300 | Area Drain | | 1.00 | 1 | CBMHB0779 | Jensen CB 1212 | Area Drain | Grate | 0.17 | 0.66 | 0.174 | | OG | 10 | X2 | OG10X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 1.22 | 3.39 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0780 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.068 | | XX | XX | 70 | XXXXX70 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P210 | Area Drain | | 10.00 | 2 | CBMHB0784 | | Area Drain | Grate | 3.33 | 0.66 | 0.006 | | OG | X1 | 10 | OGX110 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.54 | 34.35 |
| City | Civic Center | | D-879_C300 | Area Drain | 4" | 0.33 | | CBMHB0785 | NDS | Area Drain | Grate | 0.09 | 0.66 | 0.032 | | OG | 04 | 20 | OG0420 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 0.54 | 1.72 |
| City | PD parking lot | | #N/A | Area Drain | 4" | 0.33 | | CBMHB0786 | NDS | Inflow | Grate | 0.09 | 0.66 | 0.040 | | OG | 04 | 50 | OG0450 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 0.74 | 2.09 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0787 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.039 | | XX | XX | 30 | XXXXX30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0788 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.181 | | XX | XX | X2 | XXXXX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | Civic Center | | D-879_C300 | Area Drain | .5x.5 | 0.50 | 0.5 | CBMHB0789 | Zurn Z-415 | Area Drain | Grate | 0.04 | 0.66 | 0.042 | | OG | 05 | 50 | OG0550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 0.02 | 1.02 |
| City | Civic Center | | D-879_P210 | Area Drain | | 10.00 | 2 | CBMHB0790 | | Area Drain | Grate | 3.33 | 0.66 | 0.147 | | OG | X1 | X1 | OGX1X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0791 | | Area Drain | Subterranean Drai | 0.00 | 0.66 | 0.103 | | XX | XX | X1 | XXXXX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | PD parking lot | | #N/A | Area Drain | 4" | 0.33 | | CBMHB0792 | NDS | Inflow | Grate | 0.09 | 0.66 | 0.023 | | OG | 04 | 20 | OG0420 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 0.54 | 1.72 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0793 | | Area Drain | | | | | | | | | | | | | | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRAWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|---|-------------------------|---------------|----------------|-----------|-------|---------|-----------|------------------|-------------|--------------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|-------|------------|
| City | Civic Center | | D-879_C300 | Area Drain | .5x.5 | 0.50 | 0.5 | CBMHB0839 | Zurn Z-415 | Area Drain | Grate | 0.04 | 0.66 | 0.086 | | OG | 05 | 90 | OG0590 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | -0.16 | 0.85 |
| City | Civic Center | | D-879_P210 | Area Drain | | | | CBMHB0840 | | Area Drain | Subterranean Drain | 0.00 | 0.66 | 0.260 | | XX | XX | XX | XXXXXX | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Civic Center | | #N/A | | | 10.00 | 2 | CBMHB0841 | | Area Drain | Grate | 3.33 | 0.66 | 0.067 | | OG | X1 | 50 | OGX150 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.40 | 81.38 |
| City | Civic Center | | #N/A | | | 10.00 | 2 | CBMHB0842 | | Area Drain | Grate | 3.33 | 0.66 | 0.334 | | OG | X1 | 50 | OGX1XX | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Civic Center | | D-879_C300 | Area Drain | .5x.5 | 0.50 | 0.5 | CBMHB0843 | Zurn Z-415 | Area Drain | Grate | 0.04 | 0.66 | 0.070 | | OG | 05 | 90 | OG0590 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | -0.16 | 0.85 |
| City | Civic Center | | #N/A | | | 10.00 | 2 | CBMHB0844 | | Area Drain | Grate | 3.33 | 0.66 | 0.163 | | OG | X1 | X2 | OGX1X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Civic Center | | #N/A | | | 3.00 | 2 | CBMHB0846 | | Area Drain | Grate | 1.00 | 0.66 | 0.019 | | OG | 30 | 10 | OG3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | Civic Center | | #N/A | | | 1.00 | 1.00 | CBMHB0847 | | Area Drain | Grate | 0.17 | 0.66 | 0.028 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Civic Center | | #N/A | | | 10.00 | 2 | CBMHB0848 | | Area Drain | Grate | 3.33 | 0.66 | 0.044 | | OG | X1 | 50 | OGX150 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.40 | 81.38 |
| City | Civic Center | | D-879_C300 | Area Drain | .5x.5 | 0.50 | 0.5 | CBMHB0849 | Zurn Z-415 | Area Drain | Grate | 0.04 | 0.66 | 0.047 | | OG | 05 | 50 | OG0550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 0.02 | 1.02 |
| City | Highland Ave & 14th St (north side of Lot 6) | | D-713_2-3 | | | 1.00 | 1 | CBMHB0850 | Alhambra Foundry | Inflow | Grate | 0.17 | 0.66 | 0.031 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Civic Center | | D-879_C300 | Area Drain | .5x.5 | 0.50 | 0.5 | CBMHB0851 | Zurn Z-415 | Area Drain | Grate | 0.04 | 0.66 | 0.064 | | OG | 05 | 50 | OG0550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 0.02 | 1.02 |
| City | Civic Center | | #N/A | | | 1.00 | 1.00 | CBMHB0852 | | Area Drain | Grate | 0.17 | 0.66 | 0.034 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Civic Center | | #N/A | | | 10.00 | 2 | CBMHB0853 | | Area Drain | Grate | 3.33 | 0.66 | 0.068 | | OG | X1 | 50 | OGX150 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.40 | 81.38 |
| City | Morningside & 13th St (N side) | | P-866_2-2 | | | 3.50 | 3.17 | CBMHB0855 | APWA 300-2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.045 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | Civic Center | | #N/A | | | 1.00 | 1.00 | CBMHB0856 | | Area Drain | Grate | 0.17 | 0.66 | 0.033 | | OG | 10 | 20 | OG1020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 1.21 | 3.35 |
| City | Civic Center | | #N/A | | | 10.00 | 2 | CBMHB0857 | | Area Drain | Grate | 3.33 | 0.66 | 0.103 | | OG | X1 | X1 | OGX1X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Civic Center | | D-879_C300 | Area Drain | | 10.00 | 2 | CBMHB0858 | | Area Drain | Grate | 3.33 | 0.66 | 0.061 | | OG | X1 | 50 | OGX150 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.40 | 81.38 |
| City | City Hall parking lot @ Morningside & 13th St | | D-879_C300 | | 1.5x1.5 | 1.50 | 1.5 | CBMHB0859 | Jensen CB 1616 | Catch Basin | Grate | 0.38 | 0.66 | 0.140 | | OG | 15 | X1 | OG15X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.03 | 7.63 |
| City | Manhattan Heights Park | | #N/A | | | 6.50 | 2 | CBMHB0860 | | Inflow | Grate | 2.17 | 0.66 | 0.049 | | OG | 65 | 50 | OG6550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.97 | 52.90 |
| City | Morningside & 13th St (S side) | | P-866_2-2 | Slope too high | | 3.50 | 3.17 | CBMHB0861 | APWA 300-2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.116 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | Valley between 15th and MBB | | W-597_3-3 | | | 10.00 | 2 | CBMHB0863 | LACFCB CB 7 | Catch Basin | Grate | 3.33 | 0.66 | 0.035 | | OG | X1 | 20 | OGX120 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 4.20 | 66.98 |
| City | 1401 Manhattan Ave | | P-803_014-117 | | 2x2 | 2.00 | 2 | CBMHB0865 | LACFCB CB 2 | Inflow | Grate | 0.67 | 0.66 | 0.035 | | OG | 20 | 20 | OG2020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 2.60 | 13.40 |
| City | parking lot 6 @ 13th Pl | | D-713_2-3 | | | 1.00 | 1 | CBMHB0867 | Alhambra Foundry | Inflow | Grate | 0.17 | 0.66 | 0.108 | | OG | 10 | X1 | OG10X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 1.22 | 3.39 |
| City | 1300 Highland Ave & 13th Pl (east side) | | P-803_019-117 | | | 3.00 | 2.83 | CBMHB0869 | | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.060 | | SG | 30 | 50 | SG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.79 | 3.36 | 28.82 |
| City | Highland Ave & 13th Pl (south side; Lot 6) | | SD-238_2-2 | | | 3.00 | 2 | CBMHB0871 | APWA 305-1 | Catch Basin | Grate | 1.00 | 0.66 | 0.008 | | OG | 30 | 10 | OG3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | 1105 Aviation Blvd | DEBRIS SCREEP-665_05-10 | | | | 3.50 | 3.17 | CBMHB0873 | LACFCB CB 12 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.038 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 13th St n/e corner @ Highland | | #N/A | | | 3.00 | 2 | CBMHB0878 | | Inflow | Grate | 1.00 | 0.66 | 0.034 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | 217 13th Pl | | SD-238_2-2 | | | 3.00 | 2 | CBMHB0879 | APWA 304 | Catch Basin | Grate | 1.00 | 0.66 | 0.062 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| City | Lot 8 (south side entrance; on west side) | | M-909_002 | | | 3.00 | 2 | CBMHB0880 | LACFCB CB 5 | Catch Basin | Grate | 1.00 | 0.66 | 0.025 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | 14th St & Ocean Dr | | P-803C_15-29 | Slope too high | | 3.50 | 3.17 | CBMHB0883 | LACFCB CB 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.121 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 1300 13th Pl | Unable to verify. | SD-238_1-2 | | | 3.50 | 3.17 | CBMHB0884 | APWA 300-2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.020 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 1220 Highland Ave (east side) | | #N/A | Slope too high | | 3.00 | 2.83 | CBMHB0887 | LACFCB CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.127 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| City | 1075 Aviation Blvd | | P-665_05-10 | | | 3.00 | 2.8333 | CBMHB0888 | LACFCB CB 12 | Catch Basin | Grate | 1.42 | 0.66 | 0.033 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.35 | 28.47 |
| City | 1221 Highland Ave (west side) | | #N/A | | | 3.00 | 2.83 | CBMHB0889 | LACFCB CB 7 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.001 | 1 | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| City | The Strand | | P-874_SD-12 | | 2x1.5 | 2.00 | 1.5 | CBMHB0892 | | Catch Basin | Grate | 0.50 | 0.66 | 0.009 | | OG | 20 | 10 | OG2010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 1.64 | 5.15 |
| City | 1309 Manhattan Ave (west side on Manhattan Ave) | | SD-238_1-2 | | 4x3.5 | 4.00 | 3.5 | CBMHB0894 | APWA 305-1 | Catch Basin | Grate | 2.33 | 0.66 | 0.009 | | OG | 40 | 10 | OG4010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.18 | 24.04 |
| City | MBB & Ardmore (n/e island) | | NO DRAWING | | | 7.00 | 2 | CBMHB0896 | | Catch Basin | Grate | 2.33 | 0.66 | 0.050 | | OG | 70 | 50 | OG7050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 4.04 | 56.97 |
| City | 1308 Ocean Dr (north side of 13th Pl) | | SD-238_1-2 | | 2x3 | 2.00 | 3 | CBMHB0897 | APWA 304-D | Catch Basin | Grate | 1.00 | 0.66 | 0.031 | | OG | 20 | 20 | OG2020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| City | MBB & Ardmore (n/e island) | | P-803_013-117 | | | 14.00 | 3.17 | CBMHB0898 | LACFCB CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.031 | | S0 | X4 | 30 | S0X430 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.96 | 19.2 |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRAWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|---|-----------------|---------------|----------------------|-----------|-------|---------|-----------|----------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | 1658 8th St (south side) | | #N/A | | | 3.50 | 2.13 | CBMHB0989 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.047 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 1005 Manhattan Ave (west side) | | P-803_017-117 | | | 10.00 | 2 | CBMHB0991 | LACFCD CB 7 | Catch Basin | Grate | 3.33 | 0.66 | 0.038 | | 0G | X1 | 20 | 0GX120 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 4.20 | 66.98 |
| City | 316 9th Pl (west side) | | SD-199_5-5 | | | 7.00 | 2 | CBMHB0993 | LACFCD CB 7 | Catch Basin | Grate | 2.33 | 0.66 | 0.023 | | 0G | 70 | 20 | 0G7020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.85 | 46.89 |
| City | 711 Larsson St (east side) | | SD-157_1A-1 | Slope too high, shal | | 3.50 | 3.17 | CBMHB0996 | LACFCD CB 7 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.096 | 1.000 | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | Block 35 | | #N/A | | | | | CBMHB0997 | LACFCD CB 7 | Area Drain | Area Drain | 0.00 | 0.66 | 0.051 | | XX | XX | 50 | XXXX50 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | 900 Crest Dr & 9th St | | SD-199_5-5 | | | 10.00 | 2 | CBMHB0998 | LACFCD CB 7 | Catch Basin | Grate | 3.33 | 0.66 | 0.418 | | 0G | X1 | XX | 0GX1XX | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 4.22 | 67.84 |
| City | Block 35 | | #N/A | | | | | CBMHB0999 | LACFCD CB 7 | Area Drain | Area Drain | 0.00 | 0.66 | 0.022 | | XX | XX | 30 | XXXX30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| City | 900 Highland Ave (north side on 9th St) | | SD-199_5-5 | | | 3.50 | 2.125 | CBMHB1000 | LACFCD CB 7 | Catch Basin | Grate | 1.24 | 0.66 | 0.129 | | 0G | 35 | X1 | 0G35X1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.87 | 2.38 | 10.82 |
| City | 707 Sepulveda Blvd (west side) | | NO DRAWING | Slope too high | 3x2 | 3.00 | 2.00 | CBMHB1001 | LACFCD CB 3 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.145 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| City | 341 8th Pl | | SD-056 | Slope too high, unat | | 3.50 | 3.17 | CBMHB1002 | LACFCD CB 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.141 | 1.000 | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | The Strand | | P-874_SD-14 | | 2x.5 | 2.00 | 0.5 | CBMHB1004 | LACFCD CB 1 | Catch Basin | Grate | 0.17 | 0.66 | 0.087 | | 0G | 20 | 90 | 0G2090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 1.22 | 3.39 |
| County | 709 Valley Dr | Car in way | | | | 3.50 | 3.17 | CBMHB1006 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.029 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 417 8th St | | P-616 | | | 3.00 | 2 | CBMHB1007 | LACFCD Inlet 1 | Catch Basin | Grate | 1.00 | 0.66 | 0.010 | | 0G | 30 | 10 | 0G3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | 900 Manhattan Ave (on 9th) | | SD-199_5-5 | Car in way, Higher s | | 3.50 | 3.17 | CBMHB1008 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.012 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 901 Manhattan Ave | | P-803_017-117 | | | 3.00 | 2 | CBMHB1009 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.002 | 1 | 0G | 30 | 10 | 0G3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | 900 Manhattan Ave | | P-803_017-117 | | | 3.00 | 2 | CBMHB1010 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.003 | 1 | 0G | 30 | 10 | 0G3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | 1467 6th St (n/w on Peck) | | #N/A | | | 3.50 | 2.13 | CBMHB1011 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.048 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 1501 6th St (north side on 6th) | | #N/A | | | 7.00 | 3.17 | CBMHB1015 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.045 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 417 7th Pl | | SD-056 | | | 7.00 | 2 | CBMHB1016 | LACFCD CB 2 | Catch Basin | Grate | 2.33 | 0.66 | 0.031 | | 0G | 70 | 20 | 0G7020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.85 | 46.89 |
| City | 1659 6th St | | #N/A | | | 3.50 | 2.13 | CBMHB1017 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.038 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 820 Manhattan Ave | | P-803_017-117 | | | 10.00 | 2 | CBMHB1018 | LACFCD CB 7 | Catch Basin | Grate | 3.33 | 0.66 | 0.037 | | 0G | X1 | 20 | 0GX120 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 4.20 | 66.98 |
| City | 1658 6th St | | #N/A | | | 7.00 | 3.17 | CBMHB1023 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.057 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| City | 1500 6th St (s/e side on Peck) | | #N/A | | | 3.50 | 2.13 | CBMHB1026 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.017 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 1501 6th St on Peck (s/w side) | | #N/A | | | 3.50 | 2.13 | CBMHB1027 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.024 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 882 The Strand (s/w side on Ocean) | DEBRIS SCREEP | SD-803A_1-3 | | | 3.50 | 3.17 | CBMHB1029 | LACFCD CB 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.035 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 721 Bayview Dr & 8th St | | SD-199_4-5 | | | 3.50 | 2.13 | CBMHB1035 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.046 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 803 Manhattan Ave | | SD-261_3-7 | | | 3.50 | 2.13 | CBMHB1036 | LACFCD CB 1 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.037 | | SG | 35 | 20 | SG3520 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.80 | 3.19 | 24.30 |
| City | 132 8th St (west side on Manhattan Ave) | | SD-261_3-7 | | | 3.50 | 2.13 | CBMHB1037 | LACFCD CB 1 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.069 | 1.000 | SG | 35 | 10 | SG3510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.88 | 2.72 | 15.25 |
| City | 8th St & Ocean (n/w on 8th St) | | SD-261_3-7 | | | 3.50 | 2.13 | CBMHB1040 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.045 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | The Strand | | P-874_SD-15 | | 2x.5 | 2.00 | 0.50 | CBMHB1041 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.199 | | S0 | 20 | X2 | S020X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | 1321 5th St | Special parkway | | | | 1.50 | 3.00 | CBMHB1042 | LACFCD CB 1 | Inflow | Side Inlet | 0.00 | 0.66 | 0.032 | | S0 | XX | 30 | S0XX30 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 0.72 | 2.06 |
| City | 1541 5th St | | #N/A | | | 7.00 | 3.17 | CBMHB1045 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.021 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| City | The Strand | | P-874_SD-15 | | 2x.5 | 2.00 | 0.50 | CBMHB1049 | LACFCD CB 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.008 | | S0 | 20 | 10 | S02010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.05 | 2.87 |
| City | 700 The Strand (west side on Ocean) | | SD-034 | | 4x2 | 4.00 | 2.00 | CBMHB1053 | LACFCD CB 38 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.017 | | S0 | 40 | 10 | S04010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.75 | 5.74 |
| City | 1501 3rd St (east side on Peck) | | #N/A | 2'SQ Grate on other | | 3.50 | 3.17 | CBMHB1054 | LACFCD CB 39 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.002 | 1 | S0 | 35 | 00 | S03500 | 0.33 | 0.3 | 0.6 | 1 | 1.8 | 6 | 14.25 | 0 | 0 | 0 | 1.72 | 1.57 | 4.80 |
| City | 511 4th St (south side) | | SD-209 | | | 3.00 | 2 | CBMHB1055 | LACFCD CB 5 | Catch Basin | Grate | 1.00 | 0.66 | 0.006 | | 0G | 30 | 10 | 0G3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| City | The Strand | | P-874_SD-15 | Unable to Verify | | 3.50 | 3.17 | CBMHB1056 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.013 | | S0 | 35 | 10 | S03510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.61 | 5.02 |
| City | 820 3rd St (dead end west of John) | | P-587_043 | | | 3.50 | 3.17 | CBMHB1058 | LACFCD CB 38 | Inflow | Side Inlet | 0.00 | 0.66 | 0.029 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| City | 517 Highland Ave | | SD-255_4-4 | | 7x5.5 | 7.00 | 5.50 | CBMHB1059 | APWA 301-2 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.007 | | SG | 70 | 10 | SG7010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.81 | 3.01 | 20.24 |
| City | The Strand | | P-874_SD-15 | | 2x.5 | 2.00 | 0.50 | CBMHB1065 | LACFCD CB 1 | Catch Basin | Side Inlet | | | | | | | | | | | | | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|------------|---|--------------------------|---------|-------------------|-----------|-------|---------|-----------|----------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | 1400 Artesia (Mira Coasta High School) | DEBRIS SCREEP-698A_22-40 | | Slope too high | | 21.00 | 3.17 | CBMH1197 | 40 | Inflow | Side Inlet | 0.00 | 0.66 | 0.512 | | S0 | X5 | 10 | S0X510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 3.41 | 30.13 |
| City | 1400 Artesia (Mira Coasta High School) | DEBRIS SCREEP-698A_22-40 | | | | 3.50 | 3.17 | CBMH1198 | 39 | Inflow | Side Inlet | 0.00 | 0.66 | 0.063 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| City | 1727 Artesia Blvd | SD-181_3-6 | | | | 14.00 | 3.17 | CBMH1199 | LACFCD CB 6 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.016 | | SG | X4 | 10 | SGX410 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.74 | 3.41 | 30.26 |
| City | 1751 Artesia Blvd | SD-181_3-6 | | | | 14.00 | 3.17 | CBMH1200 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.032 | | S0 | X4 | 30 | S0X430 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.96 | 19.24 |
| El Segundc | Rosecrans Ave in El Segundo | #N/A | | | | 6.50 | 2.83 | CBOTH0032 | LACFCD CB 6 | Catch Basin | Grate and Side | 2.00 | 0.66 | 0.009 | | SG | 65 | 10 | SG6510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.88 | 3.39 | 29.79 |
| Hawthorne | Marine & Aviation (n/e side) in Hawthorne | SD-169_2-6 | | | | 7.00 | 3.17 | CBOTH0422 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.010 | | S0 | 70 | 10 | S07010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 2.31 | 10.04 |
| Redondo | Aviation north of 19th St (east side) in RB | #N/A | | | | 14.00 | 3.17 | CBOTH0533 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.026 | | S0 | X4 | 30 | S0X430 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.96 | 19.24 |
| Hermosa | Manhattan Ave & Homer St | P-824_2-7DUP | | | | 3.00 | | CBOTH1169 | | Inflow | Grate | 1.00 | 0.66 | 0.024 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| Redondo | Artesia Blvd in Redondo Beach | P-698A_22-40 | | | | 7.00 | 3.17 | CBOTH1201 | 39 | Inflow | Side Inlet | 0.00 | 0.66 | 0.042 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| Redondo | Artesia Blvd in Redondo Beach | P-698A_22-40 | | School bus in way | | 14.00 | 2.83 | CBOTH1202 | 39 | Inflow | Grate and Side | 4.00 | 0.66 | 0.041 | | SG | X4 | 50 | SGX450 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.78 | 4.77 | 118.28 |
| Redondo | 1727 Artesia Blvd | SD-181_3-6 | | | | 14.00 | 3.17 | CBOTH1203 | LACFCD CB 3 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.030 | | S0 | X4 | 30 | S0X430 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.96 | 19.24 |
| Private | Manhattan Marketplace | P-821_4-4 | | | | | | CBPRV0051 | | Catch Basin | Grate | 0.00 | 0.66 | 0.009 | | OG | XX | 10 | OGXX10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 0.00 | | 0.00 |
| Private | In Fry's parking lot; east side | SD-207 | | | | 7.00 | 3.17 | CBPRV0052 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.078 | | S0 | 70 | 80 | S07080 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| Private | 1800 Rosecrans Ave (s/e of il Fornaio) | ROSECRANS_REDO | 4x4 | 4.00 | 4.00 | 4.00 | 4.00 | CBPRV0070 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.062 | | S0 | 40 | 50 | S04050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.84 | 6.28 |
| Private | 1800 Rosecrans Ave | ROSECRANS_REDO | 4x4 | 4.00 | 4.00 | 4.00 | 4.00 | CBPRV0074 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.213 | | S0 | 40 | X2 | S040X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.84 | 6.28 |
| Private | 1800 Rosecrans Ave | ROSECRANS_REDO | 4x4 | 4.00 | 4.00 | 4.00 | 4.00 | CBPRV0075 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.206 | | S0 | 40 | X2 | S040X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.84 | 6.28 |
| Private | Manhattan Marketplace | SD-232_2-2 | 4x4 | 4.00 | 4.00 | 4.00 | 4.00 | CBPRV0080 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.128 | | S0 | 40 | X1 | S040X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.84 | 6.28 |
| Private | 1500 Rosecrans Ave (south/center side of parking I | P-823_3-3 | 4.5x3.5 | 4.50 | 3.50 | 3.50 | 3.50 | CBPRV0081 | LACFCD CB 2-D1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.130 | | S0 | 45 | X1 | S045X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| Private | 1500 Rosecrans Ave (south/center side of parking I | P-823_2-3 | 3x2 | 3.00 | 2 | 2 | 2 | CBPRV0087 | LACFCD CB 1 | Catch Basin | Grate | 1.00 | 0.66 | 0.091 | | OG | 30 | 90 | OG3090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| Private | 1500 Rosecrans Ave (south/center side of parking I | P-823_2-3 | 3x2 | 3.00 | 2 | 2 | 2 | CBPRV0089 | | Catch Basin | Grate | 1.00 | 0.66 | 0.217 | | OG | 30 | X2 | OG30X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| Private | South of Movie Theater parking lot | SD-227_2-6 | 4.5x4.5 | 4.50 | 4.50 | 4.50 | 4.50 | CBPRV0096 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.190 | | S0 | 45 | X2 | S045X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| Private | n/w of Macy's Women | SD-227_2-6 | 4.5x4.5 | 4.50 | 4.50 | 4.50 | 4.50 | CBPRV0097 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.147 | | S0 | 45 | X1 | S045X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| Private | North of Macy's Women; adjacent to Village Dr entr. | SD-227_2-6 | 3x2 | 3.00 | 2.00 | 2.00 | 2.00 | CBPRV0105 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.142 | | S0 | 30 | X1 | S030X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.55 | 4.71 |
| Private | 1440 Rosecrans Ave (south side of parking lot on P | 1440_ROSECRANS | 2x2 | 2.00 | 2 | 2 | 2 | CBPRV0106 | | Catch Basin | Grate | 0.67 | 0.66 | 0.095 | | OG | 20 | 90 | OG2090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.61 | 13.57 |
| Private | s/w of 1440 Rosecrans offices on Parkview Ave | 1440_ROSECRANS | 2x2 | 2.00 | 2 | 2 | 2 | CBPRV0107 | | Catch Basin | Grate | 0.67 | 0.66 | 0.020 | | OG | 20 | 90 | OG2020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 2.60 | 13.40 |
| Private | 1440 Rosecrans Ave (south side of parking lot on P | 1440_ROSECRANS | 2x2 | 2.00 | 2 | 2 | 2 | CBPRV0108 | | Catch Basin | Grate | 0.67 | 0.66 | 0.110 | | OG | 20 | X1 | OG20X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.61 | 13.57 |
| Private | Park Wy & Parkview Ave (n/e side on Park Wy; in p | SD-221_3-5 | 3x2 | 3.00 | 2 | 2 | 2 | CBPRV0110 | LACFCD CB 1 | Catch Basin | Grate | 1.00 | 0.66 | 0.128 | | OG | 30 | X1 | OG30X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| Private | n/w of Macy's Women | #N/A | 4.5x4.5 | 4.50 | 4.50 | 4.50 | 4.50 | CBPRV0111 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.112 | | S0 | 45 | X1 | S045X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| Private | n/w of Macy's Women | SD-227_2-6 | 4.5x4.5 | 4.50 | 4.50 | 4.50 | 4.50 | CBPRV0115 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.115 | | S0 | 45 | X1 | S045X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| Private | Park Wy & Parkview Ave (s/w side on Parkview) | NO DRAWING | 4.5x4.5 | 4.50 | 4.50 | 4.50 | 4.50 | CBPRV0117 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.056 | | S0 | 45 | 50 | S04550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| Private | 1334 Parkview Ave (n/w side of parking lot) | SD-223_2-2 | | | xx | xx | | CBPRV0120 | LACFCD CB 4 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.079 | | S0 | XX | 10 | S0XX10 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 0.00 | | 0.00 |
| Private | Parkview Ave e/o Market Pl (N side) | P-821_4-4 | | | | | | CBPRV0129 | | Catch Basin | Grate | 0.00 | 0.66 | 0.015 | | OG | XX | 10 | OGXX10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 0.00 | | 0.00 |
| Private | East of Manhattan Village Dental | SD-227_3-6 | | | xx | xx | | CBPRV0131 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.011 | | S0 | XX | 10 | S0XX10 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 0.00 | | 0.00 |
| Private | 1400 Parkview Ave (Marriott Hotel parking lot) | 1400_PARKVIEW_M/ | 4x3 | 4.00 | 3 | 3 | 3 | CBPRV0132 | | Catch Basin | Grate | 2.00 | 0.66 | 0.003 | 1 | OG | 40 | 10 | OG4010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 3.03 | 20.61 |
| Private | 1400 Parkview Ave (Marriott Hotel parking lot) | 1400_PARKVIEW_M/ | 3x2 | 3.00 | 2 | 2 | 2 | CBPRV0133 | | Catch Basin | Grate | 1.00 | 0.66 | 0.003 | 1 | OG | 30 | 10 | OG3010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 2.33 | 10.30 |
| Private | Village Dr & Parkview Ave (s/e corner) | SD-227_3-6 | | | | | | CBPRV0134 | LACFCD CB 7 | Catch Basin | Grate | 0.00 | 0.66 | 0.006 | | OG | XX | 10 | OGXX10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 0.00 | | 0.00 |
| Private | Parkview Ave e/o Market Pl (N side) | #N/A | | | | | | CBPRV0136 | | Catch Basin | Grate | 0.00 | 0.66 | 0.002 | 1 | OG | XX | 10 | OGXX10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 0.00 | | 0.00 |
| Private | 1800 Rosecrans Ave | ROSECRANS_REDO | 4x4 | 4.00 | 4.00 | 4.00 | 4.00 | CBPRV0140 | | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.017 | | S0 | 40 | 10 | S04010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.75 | 5.74 |
| Private | 3400 Sepulveda Blvd (westof Macy's Women) | SD-227_3-6 | 3x2 | 3.00 | 2 | 2 | 2 | CBPRV0143 | LACFCD CB 6 | Catch Basin | Grate | 1.00 | 0.66 | 0.028 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|---------|--|--------|-----------------|--------------------|-----------|-------|---------|-----------|-----------------|-------------|----------------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| Private | s/e of Macy's Men in parking lot | | SD-227_3-6 | | 4.5x4.5 | 4.50 | 4.50 | CBPRV0293 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.009 | | S0 | 45 | 10 | S04510 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 0 | 0 | 0 | 1.63 | 1.86 | 6.46 |
| Private | Studios | | 1600_ROSECRANS_ | | 3x2 | 3.00 | 2 | CBPRV0295 | APWA 304-1 | Catch Basin | Grate | 1.00 | 0.66 | 0.074 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| Private | n/e of Jenny Craig (2970 Sep) | | SD-227_3-6 | | 4.5x4.5 | 4.50 | 4.50 | CBPRV0303 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.089 | | S0 | 45 | 90 | S04590 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| Private | Northrop Grumman | | #N/A | | | 1.00 | 1 | CBPRV0305 | Alhambra A-2012 | Catch Basin | Grate | 0.17 | 0.66 | 0.056 | | OG | 10 | 50 | OG1050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 1.40 | 4.07 |
| Private | 3004 N Sepulveda (s/e of See's Candy in parking lot) | | SD-227_3-6 | | 3x2 | 3.00 | 2 | CBPRV0307 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.036 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| Private | Northrop Grumman | | #N/A | | | 1.00 | 1 | CBPRV0310 | Alhambra A-2012 | Catch Basin | Grate | 0.17 | 0.66 | 0.065 | | OG | 10 | 50 | OG1050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 1.40 | 4.07 |
| Private | Northrop Grumman | | #N/A | | | 1.00 | 1 | CBPRV0311 | Alhambra A-2012 | Catch Basin | Grate | 0.17 | 0.66 | 0.018 | | OG | 10 | 10 | OG1010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 0.54 | 1.72 |
| Private | Northrop Grumman | | #N/A | | | 1.00 | 1 | CBPRV0312 | Alhambra A-2012 | Catch Basin | Grate | 0.17 | 0.66 | 0.002 | 1 | OG | 10 | 10 | OG1010 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 2.04 | 0.54 | 1.72 |
| Private | Northrop Grumman | | #N/A | | | 1.00 | 1 | CBPRV0326 | Alhambra A-2012 | Catch Basin | Grate | 0.17 | 0.66 | 0.221 | | OG | 10 | X2 | OG10X2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 1.22 | 3.39 |
| Private | Across from Sav-on entrance (on west side of street) | | SD-227_4-6 | | 6.5x2 | 6.50 | 2 | CBPRV0334 | LACFCD CB 7 | Catch Basin | Grate | 2.17 | 0.66 | 0.065 | | OG | 65 | 50 | OG6550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.97 | 52.90 |
| Private | Studios | | 1600_ROSECRANS_ | | | xx | xx | CBPRV0338 | APWA 304-1 | Catch Basin | Grate | 0.00 | 0.66 | 0.130 | | OG | XX | X1 | OGXXX1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 0.00 | 0.00 | 0.00 |
| Private | Studios | | 1600_ROSECRANS_ | | | xx | xx | CBPRV0339 | APWA 304-1 | Catch Basin | Grate | 0.00 | 0.66 | 0.077 | | OG | XX | 90 | OGXX90 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 0.00 | 0.00 | 0.00 |
| Private | Studios | | 1600_ROSECRANS_ | | | xx | xx | CBPRV0341 | APWA 300-1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.050 | | S0 | XX | 50 | S0XX50 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 0.00 | 0.00 | 0.00 |
| Private | East of Cal Fed Bank in parking lot | | SD-227_4-6 | | 3x2 | 3.00 | 2 | CBPRV0353 | LACFCD CB 6 | Catch Basin | Grate | 1.00 | 0.66 | 0.067 | | OG | 30 | 50 | OG3050 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 3.20 | 24.41 |
| Private | 2710 Sepulveda Blvd (north side of entrance) | | SD-227_4-6 | | 7x6 | 7.00 | 6.00 | CBPRV0359 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.026 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| Private | 2710 Sepulveda Blvd (south side of entrance) | | SD-227_4-6 | | 7x6 | 7.00 | 6.00 | CBPRV0367 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.040 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| Private | 2640 Sepulveda Blvd (across from Reed's Rest; west side) | | SD-227_4-6 | | 3x2 | 3.00 | 2 | CBPRV0372 | LACFCD CB 7 | Catch Basin | Grate | 1.00 | 0.66 | 0.094 | | OG | 30 | 90 | OG3090 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| Private | 2620 Sepulveda Blvd (in Coco's parking lot) | | SD-227_4-6 | | 4.5x4.5 | 4.50 | 4.50 | CBPRV0387 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.111 | | S0 | 45 | X1 | S045X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.95 | 7.06 |
| County | 2700 Ocean Drive (west side) | | SD-265_4-7 | | | 3.50 | 2.13 | CBPRV0440 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.046 | | S0 | 35 | 50 | S03550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| County | 2620 The Strand & 27th St | | SD-265_4-7 | | | 7.00 | 3.17 | CBPRV0441 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.043 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| County | 116 26th St (north side of 26th St) | | SD-250_3-4 | Revised asbuilt | | 6.50 | 2.83 | CBPRV0456 | APWA 301 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.047 | | SG | 65 | 50 | SG6550 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 1.35 | 6 | 13 | 1.74 | 3.53 | 34.11 |
| County | 2520 Ocean Dr & 28th St (n/e side on 28th St) | | #N/A | | | 3.00 | 2.83 | CBPRV0459 | APWA 301 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.033 | | SG | 30 | 20 | SG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 1.3 | 6 | 10.75 | 1.81 | 3.16 | 23.68 |
| County | 2520 Ocean Dr & 28th St (s/e side on 28th St) | | SD-250_3-4 | Slope more than Ca | | 3.00 | 2.83 | CBPRV0462 | APWA 301 | Catch Basin | Grate and Side | 1.00 | 0.66 | 0.017 | | SG | 30 | 10 | SG3010 | 0.33 | 0.3 | 0.6 | 1 | 2.1 | 6.5 | 15 | 1.25 | 6.2 | 14.25 | 1.89 | 2.68 | 14.54 |
| County | 212 24th St & Bayview Dr (west side on 24th St) | | SD-252_3A-6 | | | 7.00 | 3.17 | CBPRV0487 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.118 | | S0 | 70 | X1 | S070X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| County | 2401 Manhattan Ave & 24th St (n/w side on Manhat) | | SD-196C_08-14 | | | 3.50 | 2.13 | CBPRV0497 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.077 | | S0 | 35 | 80 | S03580 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.70 | 5.49 |
| County | 2401 Ocean Dr & 24th St (n/w side on Ocean) | | SD-196C_08-14 | | | 3.50 | 2.13 | CBPRV0508 | LACFCD CB 1 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.021 | | S0 | 35 | 30 | S03530 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.57 | 4.81 |
| County | 115 21st St & Ocean Dr (n/w side on 21st St) | | SD-196C_06-14 | | | 7.00 | 3.17 | CBPRV0557 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.028 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| County | 112 21st St & Ocean Dr (s/e corner) | | SD-196C_06-14 | | | 7.00 | 3.17 | CBPRV0558 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.025 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| County | 21st St & Ocean Dr (s/w corner) | | S-241_002 | | | 3.00 | 2 | CBPRV0562 | LACFCD CB 4 | Catch Basin | Grate | 1.00 | 0.66 | 0.032 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| County | 2100 The Strand & 21st St (at end of 21st St before American Martyrs Church) | | S-241_002 | | | 7.00 | 3.17 | CBPRV0565 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.062 | 1.000 | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| Private | American Martyrs Church | | 1400_DEEGAN1 | | | | | CBPRV0599 | | Inflow | Grate | 0.00 | 0.66 | 0.017 | | OG | XX | 10 | OGXX10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 1.25 | 6.2 | 14.25 | 0.00 | 0.00 | 0.00 |
| Private | American Martyrs Church | | 1400_DEEGAN1 | | | xx | xx | CBPRV0608 | APWA 151-1 TYP | Inflow | Grate | 0.00 | 0.66 | 0.054 | | OG | XX | 50 | OGXX50 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 0.00 | 0.00 | 0.00 |
| County | 1400 Pine Ave & 14th St (east side on Pine) | | SD-099_04-25 | | | 7.00 | 3.17 | CBPRV0614 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.026 | | S0 | 70 | 30 | S07030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 2.26 | 9.62 |
| Private | Target | | 1200_SEPULVEDA | | 2.5x1 | 2.50 | 1 | CBPRV0617 | | Catch Basin | Grate | 0.42 | 0.66 | 0.039 | | OG | 25 | 20 | OG2520 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 2.13 | 8.37 |
| County | 1313 Pine Ave & 14th St (west side on Pine) | | SD-099_04-25 | | | 7.00 | 3.17 | CBPRV0629 | LACFCD CB 2 | Catch Basin | Side Inlet | 0.00 | 0.66 | 0.047 | | S0 | 70 | 50 | S07050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 2.40 | 10.98 |
| Private | Target | | #N/A | | 2.5x1.5 | 2.50 | 1.5 | CBPRV0638 | | Catch Basin | Grate | 0.63 | 0.66 | 0.057 | | OG | 25 | 50 | OG2550 | 0.33 | 0.175 | 0.348 | 0.6 | 0 | 0 | 0 | 1.35 | 6 | 13 | 1.85 | 2.73 | 15.26 |
| Private | Target | | 1200_SEPULVEDA | | | xx | xx | CBPRV0663 | | Catch Basin | Grate | 0.00 | 0.66 | 0.142 | | OG | XX | X1 | OGXXX1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 0.00 | 0.00 | 0.00 |
| Private | Target | | 1200_SEPULVEDA | | | xx | xx | CBPRV0664 | | Catch Basin | Grate | 0.00 | 0.66 | 0.155 | | OG | XX | X2 | OGXXX2 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 0.00 | 0.00 | 0.00 |
| Private | Target | | 1200_SEPULVEDA | | | xx | xx | CBPRV0679 | | Catch Basin | Grate | 0.00 | 0.66 | 0.083 | | OG | XX | 90 | OGXX90 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 0.00 | 0.0 | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRAWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|---|--------|--------------|-----------------------|-----------|-------|---------|-----------|-----------------|-------------|---------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| County | 509 Longfellow Dr & Ingleside Dr (s/w side on Longfellow) | | SD-177_05-15 | | | 3.00 | 2 | CBPRV1178 | LACFCD CB 4 | Catch Basin | Grate | 1.00 | 0.66 | 0.035 | | OG | 30 | 20 | OG3020 | 0.33 | 0.2 | 0.425 | 0.6 | 0 | 0 | 0 | 1.3 | 6 | 10.75 | 1.94 | 3.00 | 20.10 |
| County | 509 Longfellow Dr & Ingleside Dr (s/e side on Ingleside) | | SD-177_05-15 | | | 3.00 | 2 | CBPRV1179 | LACFCD CB 4 | Catch Basin | Grate | 1.00 | 0.66 | 0.104 | | OG | 30 | X1 | OG30X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 3.01 | 20.35 |
| County | Polliwog Park | | #N/A | | | | | OCLAC0640 | | Outflow | Outflow | 0.00 | 0.66 | 0.104 | | NA | NA | X1 | NANAX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| County | Polliwog Park | | #N/A | | | | | OCLAC0642 | | Outflow | Outflow | 0.00 | 0.66 | 0.108 | | NA | NA | X1 | NANAX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | The Strand | | #N/A | | | | | OCMHB0006 | | Outflow | Outflow | 0.00 | 0.66 | 0.203 | | NA | NA | X2 | NANAX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | El Porto Lot (n/e side; 40th St) | | #N/A | | | | | OCMHB0021 | | Outflow | Outflow | 0.00 | 0.66 | 0.020 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | w/o parking lot @ 40th St | | #N/A | | | | | OCMHB0022 | | Outflow | Outflow | 0.00 | 0.66 | 0.022 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 39th St w/o Highland north side | | #N/A | | | | | OCMHB0026 | | Outflow | Outflow | 0.00 | 0.66 | 0.024 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Bike Path (n/o El Porto St) | | #N/A | | | | | OCMHB0029 | | Outflow | Outflow | 0.00 | 0.66 | 0.027 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Highland Ave & 38th Pl (south side) | | #N/A | | | | | OCMHB0033 | | Outflow | Outflow | 0.00 | 0.66 | 0.055 | | NA | NA | 50 | NANA50 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 3714 Highland Ave (south side on 38th St) | | #N/A | | | | | OCMHB0046 | | Outflow | Outflow | 0.00 | 0.66 | 0.012 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Bike Path (38th St) | | #N/A | | | | | OCMHB0085 | | Outflow | Outflow | 0.00 | 0.66 | 0.016 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 229 Rosecrans Ave (n/w of Highland) | | #N/A | | | | | OCMHB0093 | LACFCD Culvert | Outflow | Outflow | 0.00 | 0.66 | 0.004 | 1 | NA | NA | 00 | NANA00 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Public Works Yard | | #N/A | | | | | OCMHB0104 | | Outflow | Outflow | 0.00 | 0.66 | 0.008 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 3201 Laurel Ave | | #N/A | | | | | OCMHB0183 | LACFCD CB 5 | Outflow | Outflow | 0.00 | 0.66 | 0.036 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 31st St e/o Alma Ave north side | | #N/A | | | | | OCMHB0271 | | Outflow | Outflow | 0.00 | 0.66 | 0.011 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Ardmore Ave @ Palm Ave | | #N/A | | | | | OCMHB0390 | | Outflow | Outflow | 0.00 | 0.66 | 0.017 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 2513 Walnut Ave | | #N/A | | | | | OCMHB0399 | | Outflow | Outflow | 0.00 | 0.66 | 0.013 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 835 Marine Ave (south side on Ardmore Ave) | | #N/A | | | | | OCMHB0413 | | Outflow | Outflow | 0.00 | 0.66 | 0.027 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Marine Ave & Redondo Ave (east side on Redondo) | | #N/A | Discharge to open s | | | | OCMHB0420 | | Outflow | Outflow | 0.00 | 0.66 | 0.017 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 2412 Poinsettia Ave | | #N/A | Justin confirmed | | | | OCMHB0428 | | Outflow | Outflow | 0.00 | 0.66 | 0.004 | 1 | NA | NA | 00 | NANA00 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 2520 25th St & Highland (s/e side) | | #N/A | | | | | OCMHB0439 | | Outflow | Outflow | 0.00 | 0.66 | 0.019 | | NA | NA | 10 | NANA10 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 229 25th Pl | | #N/A | Per Justin | | | | OCMHB0451 | | Outflow | Outflow | 0.00 | 0.66 | 0.078 | | NA | NA | 80 | NANA80 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 1314 21st St (south side) | | #N/A | | | | | OCMHB0495 | APWA 151-0 | Outflow | Outflow | 0.00 | 0.66 | 0.067 | | NA | NA | 70 | NANA70 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 1300 21st St | | #N/A | | | | | OCMHB0496 | | Outflow | Outflow | 0.00 | 0.66 | 0.050 | | NA | NA | 50 | NANA50 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 2215 Alma on 23rd St | | #N/A | | | | | OCMHB0501 | | Outflow | Outflow | 0.00 | 0.66 | 0.088 | | NA | NA | 90 | NANA90 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 557 21st St | | #N/A | | | | | OCMHB0504 | | Outflow | Outflow | 0.00 | 0.66 | 0.029 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 1729 Pacific Ave | | #N/A | | | | | OCMHB0543 | LACFCD Outlet 3 | Outflow | Outflow | 0.00 | 0.66 | 0.208 | | NA | NA | X2 | NANAX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 2120 The Strand | | #N/A | | | | | OCMHB0544 | | Outflow | Outflow | 0.00 | 0.66 | 0.064 | | NA | NA | 60 | NANA60 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 1541 18th St (at end of cul-de-sac) | | #N/A | | | | | OCMHB0551 | | Outflow | Outflow | 0.00 | 0.66 | 0.054 | | NA | NA | 50 | NANA50 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Live Oak Park | | #N/A | Discharge to curb pi | | | | OCMHB0554 | | Outflow | Outflow | 0.00 | 0.66 | 0.051 | | NA | NA | 50 | NANA50 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Live Oak Park | | #N/A | | | | | OCMHB0556 | | Outflow | Outflow | 0.00 | 0.66 | 0.002 | 1 | NA | NA | 00 | NANA00 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Cul-de-sac for Herrin Ave & Polliwog Park | | #N/A | | | | | OCMHB0574 | | Outflow | Outflow | 0.00 | 0.66 | 0.172 | | NA | NA | X2 | NANAX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | 15th St & AM School | | #N/A | | | | | OCMHB0586 | | Outflow | Outflow | 0.00 | 0.66 | 0.195 | | NA | NA | X2 | NANAX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Polliwog Park | | #N/A | Discharge to Polliwoc | | | | OCMHB0593 | | Outflow | Outflow | 0.00 | 0.66 | 0.134 | | NA | NA | X1 | NANAX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Valley Dr @ line of 17th Pl | | #N/A | | | | | OCMHB0596 | | Outflow | Outflow | 0.00 | 0.66 | 0.083 | | NA | NA | 80 | NANA80 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Polliwog Park | | #N/A | | | 1x1 | 1.00 | 1.00 | OCMHB0601 | | Outflow | Outflow | 0.00 | 0.66 | 0.026 | | NA | 10 | NA1030 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Polliwog Park | | #N/A | | | 1x1 | 1.00 | 1.00 | OCMHB0609 | | Outflow | Outflow | 0.00 | 0.66 | 0.075 | | NA | 10 | NA1070 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | American Martyrs Church | | #N/A | | | | | OCMHB0618 | | Outflow | Outflow | 0.00 | 0.66 | 0.028 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Valley Dr @ Joslyn Center parking lot | | #N/A | | | | | OCMHB0633 | | Outflow | Outflow | 0.00 | 0.66 | 0.028 | | NA | NA | 30 | NANA30 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Valley Dr @ City Hall Annex parking lot | | #N/A | | | | | OCMHB0641 | | Outflow | Outflow | 0.00 | 0.66 | 0.109 | | NA | NA | X1 | NANAX1 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Polliwog Park | | #N/A | | | | | OCMHB0645 | | Outflow | Outflow | 0.00 | 0.66 | 0.087 | | NA | NA | 90 | NANA90 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Polliwog Park | | #N/A | | | | | OCMHB0670 | | Outflow | Outflow | 0.00 | 0.66 | 0.152 | | NA | NA | X2 | NANAX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Civic Center (15th St) | | #N/A | | | | | OCMHB0697 | | Outflow | Outflow | 0.00 | 0.66 | 0.044 | | NA | NA | 50 | NANA50 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | Civic Center (15th St) | | #N/A | | | | | OCMHB0701 | | Outflow | Outflow | 0.00 | 0.66 | 0.055 | | NA | NA | 50 | NANA50 | 0.33 | 0.3 | 0.6 | 1 | | | | | | | | | |

| AGENCY | ADDRESS | INSERT | ASBUILT | NOTES | SIZE (CA) | Width | Breadth | AEC_CBID | STD_DRWNG | TYPE | SUBTYPE | No. Grates | CF_H | CMB_Slp_Ft | Is Sump? | Inlet Class | Size Class | Slope Class | Calc Class | %Clogging | D_Low | D_Mid | D_High | QLF_Low | QLF_Mid | QLF_High | Q_Low_G | Q_Mid_G | Q_High_G | QD_Exp | QD_b | QD_Coeff_a |
|--------|----------------------------|--------|---------|---------------------|-----------|-------|---------|-----------|-----------|----------------------------|---------|------------|------|------------|----------|-------------|------------|-------------|------------|-----------|-------|-------|--------|---------|---------|----------|---------|---------|----------|--------|------|------------|
| City | 4230 The Strand (w side S) | | #N/A | Water Quality Catch | 2x1.5 | 2.00 | 1.50 | WCMHB0012 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.032 | | S0 | 20 | 30 | S02030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.01 | 2.75 |
| City | The Strand | | #N/A | Water Quality Catch | 2x1.5 | 2.00 | 1.50 | WCMHB0015 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.204 | | S0 | 20 | X2 | S020X2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | The Strand | | #N/A | Water Quality Catch | | xx | xx | WCMHB0035 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.249 | | XX | XX | X2 | XXXXX2 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | The Strand | | #N/A | | | | | WCMHB0299 | STC 450 | WQ Stormcep/WQ Stormceptor | | 0.00 | 0.66 | 0.215 | | XX | XX | X2 | XXXXX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | The Strand | | #N/A | | | | | WCMHB0412 | STC 450 | WQ Stormcep/WQ Stormceptor | | 0.00 | 0.66 | 0.188 | | XX | XX | X2 | XXXXX2 | 0.33 | 0.3 | 0.6 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0.00 | | 0.00 |
| City | The Strand | | #N/A | Water Quality Catch | 2x1.5 | 2.00 | 1.50 | WCMHB0450 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.289 | | S0 | 20 | XX | S020XX | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | The Strand | | #N/A | Water Quality Catch | 2x1.5 | 2.00 | 1.50 | WCMHB0550 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.039 | | S0 | 20 | 30 | S02030 | 0.33 | 0.2 | 0.425 | 0.6 | 1.4 | 4 | 7 | 0 | 0 | 0 | 1.45 | 1.01 | 2.75 |
| City | 1712 The Strand | | #N/A | Water Quality Catch | 2x1.5 | 2.00 | 1.5 | WCMHB0644 | | WQ Catch Bc Grate | | 0.50 | 0.66 | 0.125 | | 0G | 20 | X1 | 0G20X1 | 0.33 | 0.15 | 0.32 | 0.6 | 0 | 0 | 0 | 1.27 | 6 | 11.75 | 1.62 | 2.32 | 10.18 |
| City | 1125 The Strand | | #N/A | Water Quality Catch | 2x1.5 | 2.00 | 1.50 | WCMHB0952 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.066 | | S0 | 20 | 70 | S02070 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | The Strand | | #N/A | Water Quality Catch | 2x.5 | 2.00 | 0.50 | WCMHB1033 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.060 | | S0 | 20 | 50 | S02050 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | The Strand | | #N/A | Water Quality Catch | 2x.5 | 2.00 | 0.50 | WCMHB1057 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.007 | | S0 | 20 | 00 | S02000 | 0.33 | 0.3 | 0.6 | 1 | 1.8 | 6 | 14.25 | 0 | 0 | 0 | 1.72 | 1.01 | 2.74 |
| City | The Strand | | #N/A | Water Quality Catch | 2x.5 | 2.00 | 0.50 | WCMHB1073 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.112 | | S0 | 20 | X1 | S020X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |
| City | The Strand | | #N/A | Water Quality Catch | 2x.5 | 2.00 | 0.50 | WCMHB1144 | | WQ Catch Bc Side Inlet | | 0.00 | 0.66 | 0.143 | | S0 | 20 | X1 | S020X1 | 0.33 | 0.175 | 0.348 | 0.6 | 1.1 | 3.1 | 7.5 | 0 | 0 | 0 | 1.56 | 1.14 | 3.14 |

Peak Flow Hydrologic Analysis


File location: C:/Users/derek.plaza/Desktop/CMB SDMP - NW02B.pdf
Version: HydroCalc 1.0.3

Input Parameters

| | |
|-------------------------------------|-----------------------|
| Project Name | CMB SDMP |
| Subarea ID | NW02B |
| Area (ac) | 414.0 |
| Flow Path Length (ft) | 5000.0 |
| Flow Path Slope (vft/hft) | 0.005 |
| 85th Percentile Rainfall Depth (in) | 0.82 |
| Percent Impervious | 0.9 |
| Soil Type | 10 |
| Design Storm Frequency | 85th percentile storm |
| Fire Factor | 0 |
| LID | True |

Output Results

| | |
|---|--------------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 0.82 |
| Peak Intensity (in/hr) | 0.1018 |
| Undeveloped Runoff Coefficient (Cu) | 0.1 |
| Developed Runoff Coefficient (Cd) | 0.82 |
| Time of Concentration (min) | 141.0 |
| Clear Peak Flow Rate (cfs) | 34.5712 |
| Burned Peak Flow Rate (cfs) | 34.5712 |
| 24-Hr Clear Runoff Volume (ac-ft) | 23.0124 |
| 24-Hr Clear Runoff Volume (cu-ft) | 1002418.9487 |

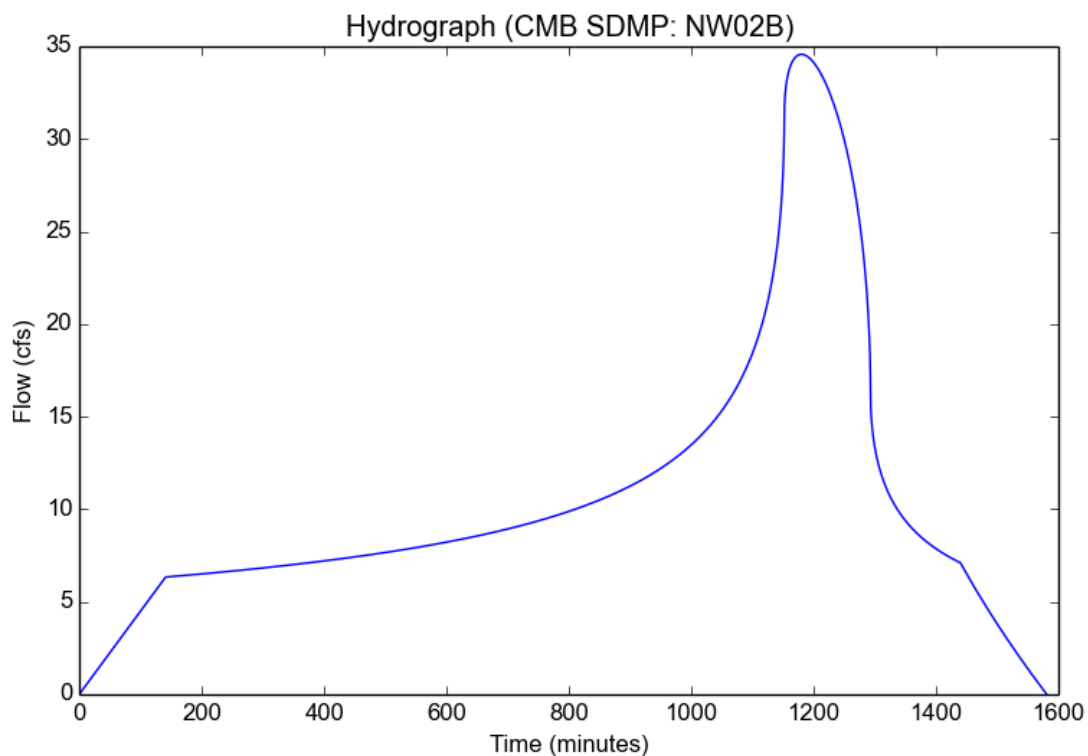

Peak Flow Hydrologic Analysis


File location: C:/Users/derek.plaza/Desktop/CMB SDMP - NE06.pdf
Version: HydroCalc 1.0.3

Input Parameters

| | |
|-------------------------------------|-----------------------|
| Project Name | CMB SDMP |
| Subarea ID | NE06 |
| Area (ac) | 183.0 |
| Flow Path Length (ft) | 4200.0 |
| Flow Path Slope (vft/hft) | 0.02 |
| 85th Percentile Rainfall Depth (in) | 0.86 |
| Percent Impervious | 0.9 |
| Soil Type | 10 |
| Design Storm Frequency | 85th percentile storm |
| Fire Factor | 0 |
| LID | True |

Output Results

| | |
|---|------------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 0.86 |
| Peak Intensity (in/hr) | 0.1286 |
| Undeveloped Runoff Coefficient (Cu) | 0.1 |
| Developed Runoff Coefficient (Cd) | 0.82 |
| Time of Concentration (min) | 95.0 |
| Clear Peak Flow Rate (cfs) | 19.2953 |
| Burned Peak Flow Rate (cfs) | 19.2953 |
| 24-Hr Clear Runoff Volume (ac-ft) | 10.6667 |
| 24-Hr Clear Runoff Volume (cu-ft) | 464641.615 |

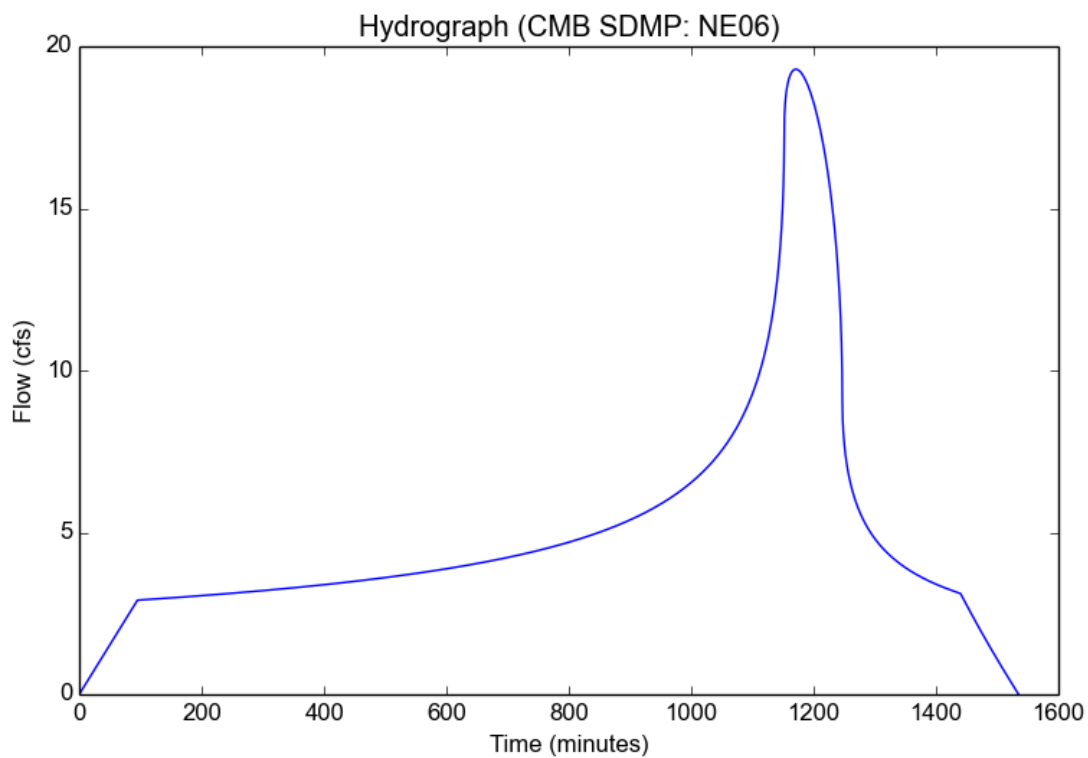

Peak Flow Hydrologic Analysis


File location: C:/Users/derek.plaza/Desktop/CMB SDMP - NW08B.pdf
Version: HydroCalc 1.0.3

Input Parameters

| | |
|-------------------------------------|-----------------------|
| Project Name | CMB SDMP |
| Subarea ID | NW08B |
| Area (ac) | 1040.0 |
| Flow Path Length (ft) | 8600.0 |
| Flow Path Slope (vft/hft) | 0.005 |
| 85th Percentile Rainfall Depth (in) | 0.8 |
| Percent Impervious | 0.9 |
| Soil Type | 10 |
| Design Storm Frequency | 85th percentile storm |
| Fire Factor | 0 |
| LID | True |

Output Results

| | |
|---|--------------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 0.8 |
| Peak Intensity (in/hr) | 0.0839 |
| Undeveloped Runoff Coefficient (Cu) | 0.1 |
| Developed Runoff Coefficient (Cd) | 0.82 |
| Time of Concentration (min) | 202.0 |
| Clear Peak Flow Rate (cfs) | 71.5552 |
| Burned Peak Flow Rate (cfs) | 71.5552 |
| 24-Hr Clear Runoff Volume (ac-ft) | 56.4165 |
| 24-Hr Clear Runoff Volume (cu-ft) | 2457503.9915 |

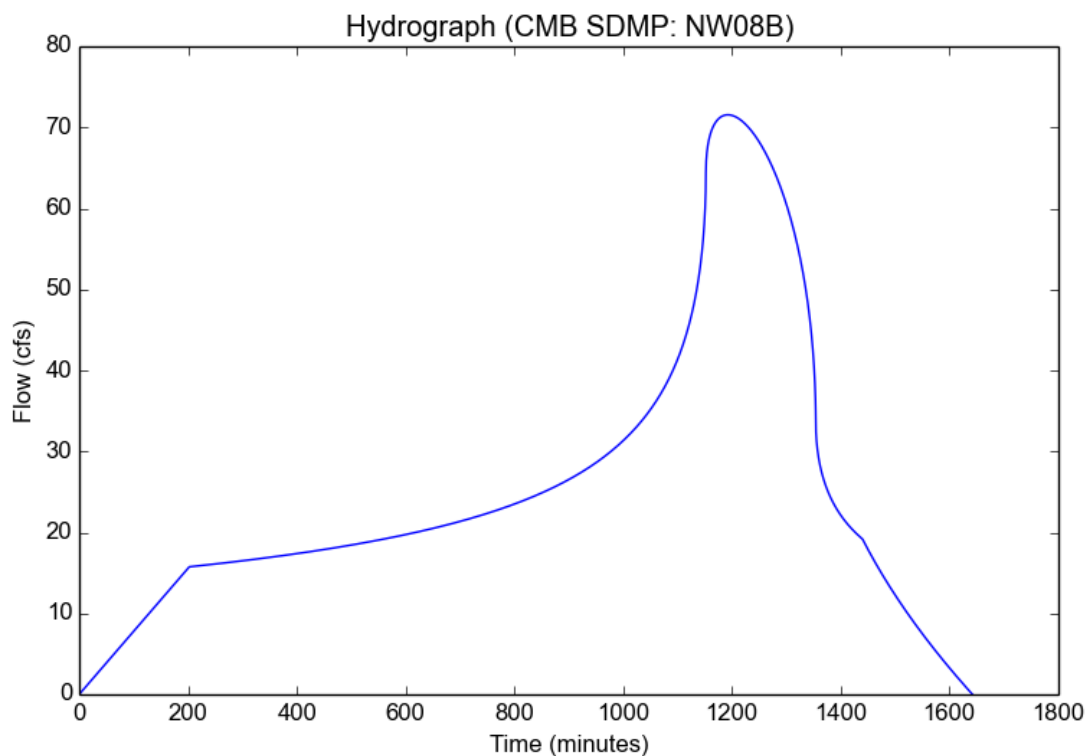

Peak Flow Hydrologic Analysis


File location: C:/Users/derek.plaza/Desktop/CMB SDMP - S02B.pdf
Version: HydroCalc 1.0.3

Input Parameters

| | |
|-------------------------------------|-----------------------|
| Project Name | CMB SDMP |
| Subarea ID | S02B |
| Area (ac) | 34.0 |
| Flow Path Length (ft) | 1700.0 |
| Flow Path Slope (vft/hft) | 0.005 |
| 85th Percentile Rainfall Depth (in) | 0.77 |
| Percent Impervious | 0.9 |
| Soil Type | 10 |
| Design Storm Frequency | 85th percentile storm |
| Fire Factor | 0 |
| LID | True |

Output Results

| | |
|---|------------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 0.77 |
| Peak Intensity (in/hr) | 0.1295 |
| Undeveloped Runoff Coefficient (Cu) | 0.1 |
| Developed Runoff Coefficient (Cd) | 0.82 |
| Time of Concentration (min) | 74.0 |
| Clear Peak Flow Rate (cfs) | 3.6096 |
| Burned Peak Flow Rate (cfs) | 3.6096 |
| 24-Hr Clear Runoff Volume (ac-ft) | 1.7743 |
| 24-Hr Clear Runoff Volume (cu-ft) | 77288.9183 |

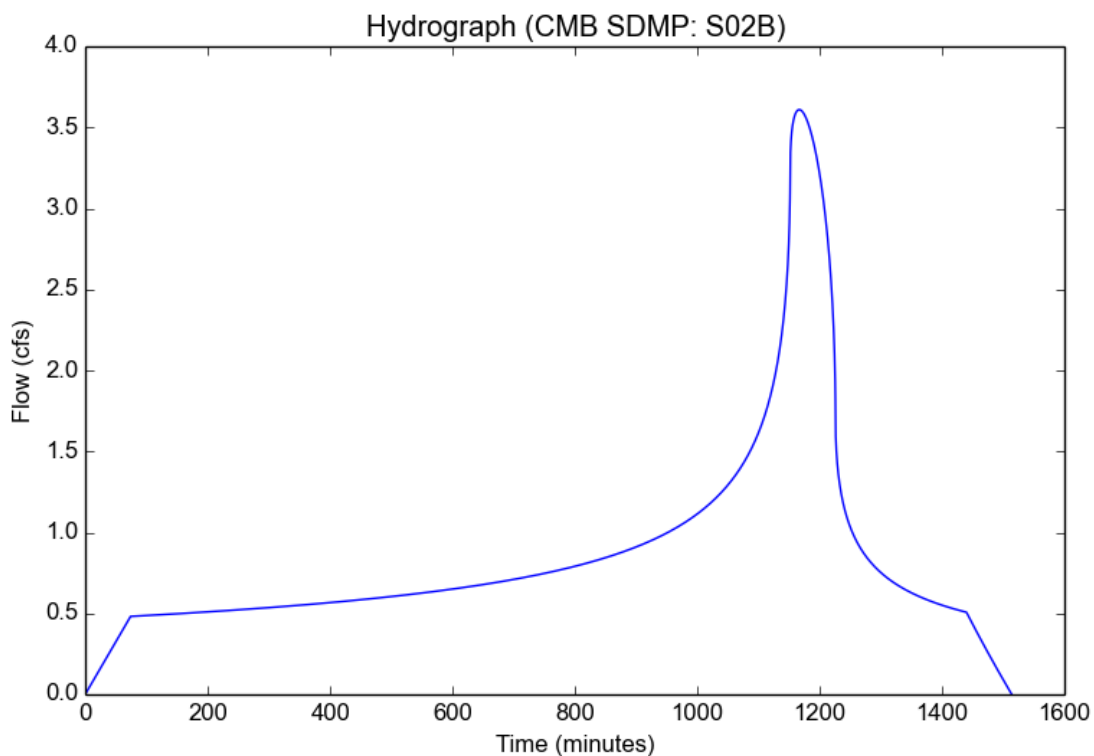

Peak Flow Hydrologic Analysis


File location: C:/Users/derek.plaza/Desktop/CMB SDMP - M01.pdf
Version: HydroCalc 1.0.3

Input Parameters

| | |
|-------------------------------------|-----------------------|
| Project Name | CMB SDMP |
| Subarea ID | M01 |
| Area (ac) | 28.0 |
| Flow Path Length (ft) | 1600.0 |
| Flow Path Slope (vft/hft) | 0.016 |
| 85th Percentile Rainfall Depth (in) | 0.8 |
| Percent Impervious | 0.9 |
| Soil Type | 10 |
| Design Storm Frequency | 85th percentile storm |
| Fire Factor | 0 |
| LID | True |

Output Results

| | |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 0.8 |
| Peak Intensity (in/hr) | 0.1533 |
| Undeveloped Runoff Coefficient (Cu) | 0.1 |
| Developed Runoff Coefficient (Cd) | 0.82 |
| Time of Concentration (min) | 56.0 |
| Clear Peak Flow Rate (cfs) | 3.5207 |
| Burned Peak Flow Rate (cfs) | 3.5207 |
| 24-Hr Clear Runoff Volume (ac-ft) | 1.5181 |
| 24-Hr Clear Runoff Volume (cu-ft) | 66127.491 |

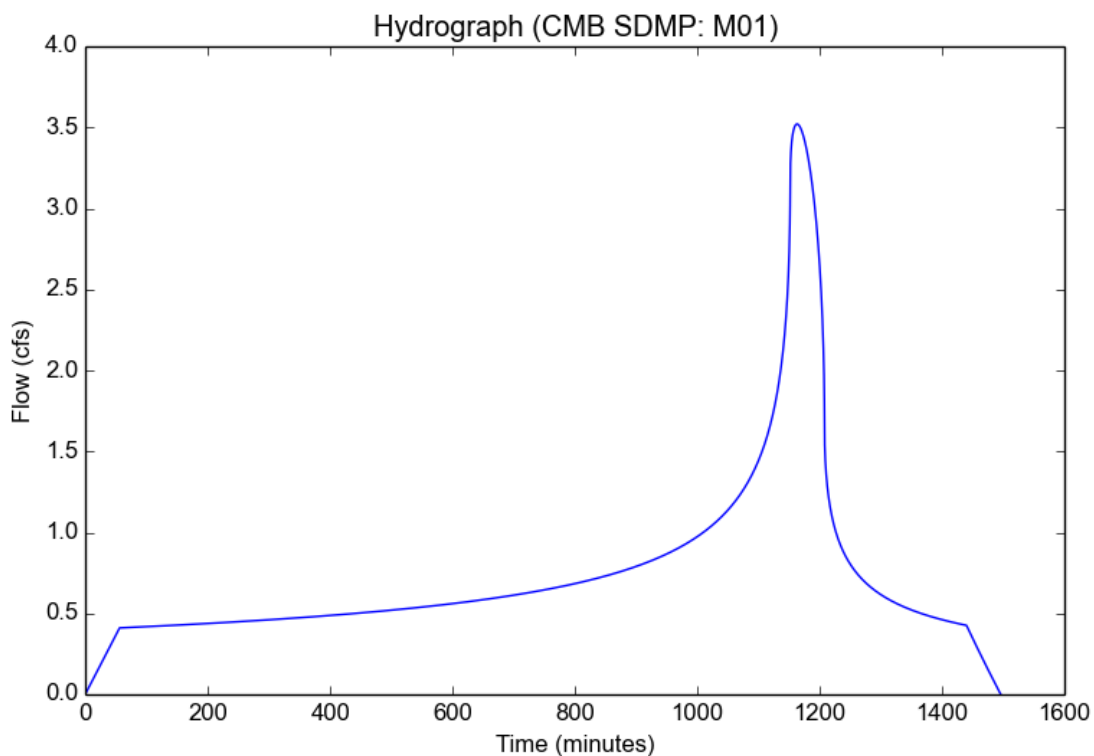

Peak Flow Hydrologic Analysis

File location: C:/Users/derek.plaza/Desktop/CMB SDMP - C10.pdf
Version: HydroCalc 1.0.3

Input Parameters

| | |
|-------------------------------------|-----------------------|
| Project Name | CMB SDMP |
| Subarea ID | C10 |
| Area (ac) | 310.0 |
| Flow Path Length (ft) | 5200.0 |
| Flow Path Slope (vft/hft) | 0.01 |
| 85th Percentile Rainfall Depth (in) | 0.82 |
| Percent Impervious | 0.9 |
| Soil Type | 10 |
| Design Storm Frequency | 85th percentile storm |
| Fire Factor | 0 |
| LID | True |

Output Results

| | |
|---|-------------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 0.82 |
| Peak Intensity (in/hr) | 0.107 |
| Undeveloped Runoff Coefficient (Cu) | 0.1 |
| Developed Runoff Coefficient (Cd) | 0.82 |
| Time of Concentration (min) | 127.0 |
| Clear Peak Flow Rate (cfs) | 27.1907 |
| Burned Peak Flow Rate (cfs) | 27.1907 |
| 24-Hr Clear Runoff Volume (ac-ft) | 17.2306 |
| 24-Hr Clear Runoff Volume (cu-ft) | 750563.2202 |

